

7 Series

Geothermal Heat Pump 3-5 ton (variable speed)




Submittal Data English Language/IP Units SD2700AN 12/17

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:



Rev.: 10/4/2017

Model Nomenclature

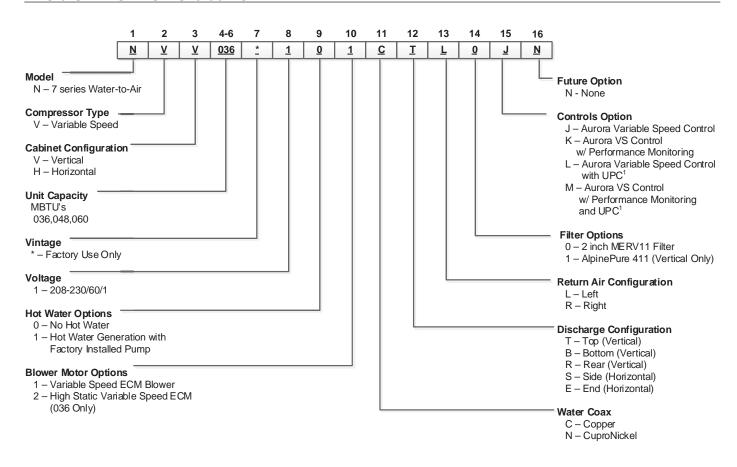

Notes:

¹ UPC is not compatible with Symphony or IntelliZone2

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





AHRI/ISO 13256-1 Performance Ratings

Variable Speed ECM Motor

AHRI/ASHRAE/ISO 13256-1 English (IP) Units

			Wa	ter Loop	Heat Pump		Grou	nd Water	Heat Pum	р	Ground Loop Heat Pump					
Model	Capacity Modulation	Airflow Clg/Htg				Heating EWT 68°F		Cooling EWT 59°F		ng O°F	Cool Full Loa Part Loa	d 77°F	Heati Full Load Part Load	32°F		
	Trouble to	cfm	Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	СОР	Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	СОР	Capacity Btu/h	EER Btu/h per W	Capacity Btu/h	СОР		
036	Full	1300/1500	32,000	18.0	50,000	5.3	38,000	31.5	41,000	4.6	36,000	22.0	32,000	3.5		
036	Part	1300/1500	11,000	21.0	17,000	7.5	13,000	47.2	14,000	5.9	14,000	37.0	13,000	5.3		
048	Full	1500/1800	41,000	17.6	67,000	5.0	49,000	31.7	55,000	4.3	46,000	21.7	43,000	3.6		
048	Part	1500/1800	16,000	22.5	24,000	7.6	19,200	53.2	19,000	5.9	19,000	41.0	16,000	5.3		
060	Full	1800/2200	50,000	16.3	78,000	4.8	60,000	28.6	65,000	4.3	56,000	19.4	51,000	3.5		
060	Part	1800/2200	20,000	21.7	29,000	7.5	23,200	45.8	23,000	6.0	23,000	36.0	20,000	5.1		

Cooling capacities based upon $80.6^{\circ}F$ DB, $66.2^{\circ}F$ WB entering air temperature Heating capacities based upon $68^{\circ}F$ DB, $59^{\circ}F$ WB entering air temperature All ratings based upon 208V operation

6/15/12

Energy Star Compliance Table

Model	Tie	er 3
Model	Ground Water	Ground Loop
036	Yes	Yes
048	Yes	Yes
060	Yes	Yes

6/1/12

Energy Star Rating Criteria

In order for water-source heat pumps to be Energy Star rated they must meet or exceed the minimum efficiency requirements listed below. Tier 3 represents the current minimum efficiency water source heat pumps must have in order to be Energy Start rated.

Tier 3: 1/1/2012 - No Effective End Date Published

Water-to-Air	EER	COP
Ground Loop	17.1	3.6
Ground Water	21.1	4.1
Water-to-Water		
Ground Loop	16.1	3.1
Ground Water	20.1	3.5






Contractor:	P.O.:
Engineer:	
Project Name:	_Unit Tag:





Vertical Dimensional Data

Top Air Discharge

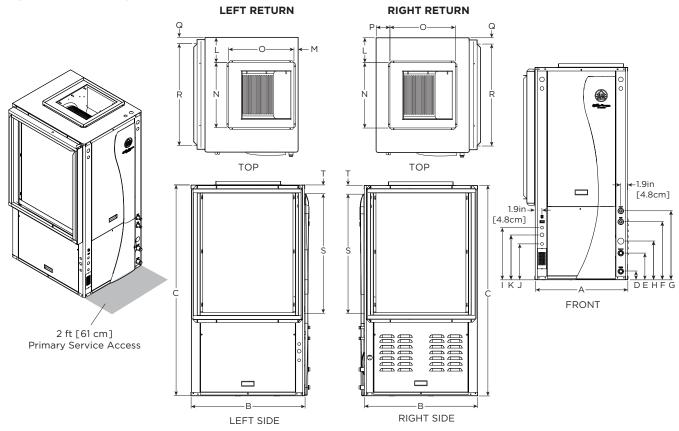

		Ove	rall Cabinet Water Connections										lectrica				ge Con installe		Return Connection using std deluxe filter rack (30.10 in)				
Vertic Flow		A	B	C Height	D Loop	E Loop	F HWG	G HWG	H Cond-	Loop Water	HWG Sweat		J 1/2 in. cond	K 3/4 in. cond	L	М	N Supply	O Supply	P	Q	R Return	S Return	т
		wiatii	Deptii	neight	In	Out	In	Out	ensate	FPT	(I.D.)	Low Voltage	Ext Pump	Power Supply			Width	Depth			Depth	Height	
036	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	1.7
036	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	4.3
048	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	30.0	1.7
048	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	76.2	4.3
060	in.	25.6	31.6	58.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	6.9	1.1	18.0	18.0	3.8	1.7	28.1	34.0	1.7
060	cm.	65.0	80.3	148.3	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	17.5	2.8	45.7	45.7	9.7	4.3	71.4	86.4	4.3
Conder	condensate is 3/4 in. PVC female glue socket and is switchable from side to front 6/29/12																						

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front
Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection. Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet

Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.

Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:




4/30/12



Vertical Dimensional Data cont.

Bottom Air Discharge

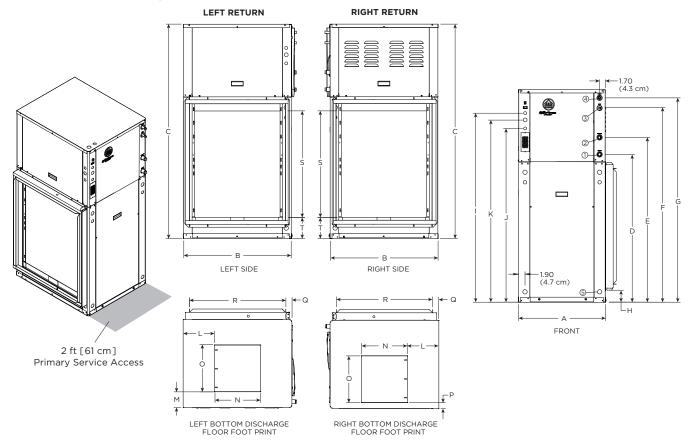

							Water	Conne	ctions			Electri	cal Kno	ckouts						Return Connection					
Bottom			rall Cab	inet	1	2	3	4	5	Loop	HWG	I 1/2 in. cond	J 1/2 in. cond	K 3/4 in. cond				Discharge Connection duct flange installed (±0.10 in)				using std deluxe filter ra (±0.10 in)			
Mod		A Width	B Depth	C Height	D In	E Out	F HWG In	G HWG Out	H Cond- ensate	FPT	Sweat (I.D.)	Low	Ext Pump	Power Supply	L	М	N Supply Width	O Supply Depth	Р	Q		S Return Height			
036-	in.	25.5	31.5	62.5	43.4	48.4	57.0	60.0	3.1	1 in.	1/2 in.	51.1	55.6	53.6	9.1	4.8	13.4	13.6	1.7	1.8	28.1	34.0	5.6		
060	cm.	64.8	80.0	158.8	110.2	122.9	144.8	152.4	7.9	Swivel	Female	129.8	141.2	136.1	23.1	12.2	34.0	34.5	4.3	4.6	71.4	86.4	14.2		

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front
Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.

Water connections extend 1.2 in. [30.5mm] beyond front of cabinet.

Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	


7 Series 700A11 3-5 Ton 60Hz





Vertical Dimensional Data cont.


Rear Air Discharge














RIGHT RETURN

Ve	rti-	Ove	rall Cab	inet			Water	Conne	ctions			_	lectrica			Dischar t flange			Return Connection using std deluxe filter rack (±0.10 in)				
cal I Disch Mo	arge	Α	B	C Height	D Loop	E Loop	F HWG	G HWG	H Cond-	Loop Water		l 1/2 in. cond	J 1/2 in. cond	K 3/4 in. cond	L Supply	M Supply	N	0	P	G	R Return	S Return	т
		wiath	рерип	пеідпі	In	Out	In	Out	ensate	e FPT (I.D.)		Low Voltage	Ext Pump	Power Supply	Width	Depth					Depth	Height	
036	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	13.3	13.6	39.4	9.1	8.1	1.7	28.1	30.0	1.7
036	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	100.1	23.1	20.6	4.3	71.4	76.2	4.3
048	in.	25.6	31.6	54.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	13.3	13.6	39.4	9.1	8.1	1.7	28.1	30.0	1.7
048	cm.	65.0	80.3	138.2	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	100.1	23.1	20.6	4.3	71.4	76.2	4.3
060	in.	25.6	31.6	58.4	2.3	7.3	15.9	18.9	10.6	1 in.	1/2 in.	14.3	9.8	12.3	13.3	13.6	43.4	9.1	8.1	1.7	28.1	34.0	1.7
1000	cm.	65.0	80.3	148.3	5.8	18.5	40.4	48.0	26.9	Swivel	Female	36.3	24.9	31.2	33.8	34.5	110.2	23.1	20.6	4.3	71.4	86.4	4.3

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front

6/29/12

Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection.

Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.


Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.


Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





Horizontal Dimensional Data

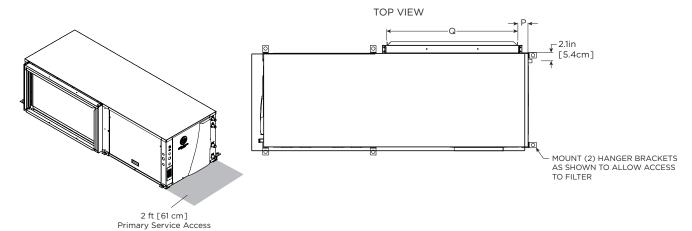

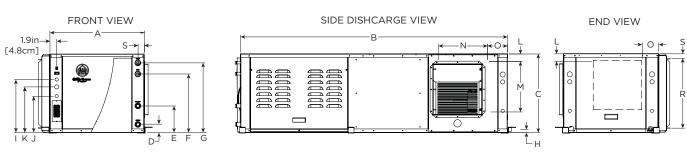

AS SHOWN LR UNIT (RR UNIT ON OPPOSITE SIDE—SAME DIMENSIONS)

												Electric	al Conn	ections					-	otuvn C	onnectio	
Horizontal Models			rall Cab	inet	Water Connections							l 1/2 in. cond	J 1/2 in. cond	K 3/4 in. cond		Discharge Connection duct flange installed (±0.10 in)			using std doluve filter rook			
	uc.i5	A Width	B Depth	C Height	D In	E Out	F HWG In	G HWG Out	H Cond- ensate	Loop Water FPT	HWG Sweat (I.D.)	Low Voltage	Ext Pump	Power Supply	L		N Supply Depth	0	Р	Q Return Depth	R Return Height	s
036	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in.	1/2 in.	14.3	9.8	12.3	SEE	13.6	13.2	SEE	2.8	40.4	18.9	1.3
036	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	Female	36.3	24.9	31.2	CHART	34.5	33.5	CHART	7.1	102.6	48.0	3.3
048	in.	25.6	77.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in.	1/2 in.	14.3	9.8	12.3	SEE	13.6	13.2	SEE	2.8	40.4	18.9	1.3
048	cm.	65.0	195.6	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	Female	36.3	24.9	31.2	CHART	34.5	33.5	CHART	7.1	102.6	48.0	3.3
060	in.	25.6	82.0	21.3	2.3	7.3	15.9	18.9	0.8	1 in.	1/2 in.	14.3	9.8	12.3	SEE	13.6	13.2	SEE	2.8	45.4	18.9	1.3
080	cm.	65.0	208.3	54.1	5.8	18.5	40.4	48.0	2.0	Swivel	Female	36.3	24.9	31.2	CHART	34.5	33.5	CHART	7.1	115.3	48.0	3.3

Condensate is 3/4 in. PVC female glue socket and is switchable from side to front

6/29/12

Unit shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.25 in. and is suitable for duct connection. Discharge flange is field installed and extends 1 in. [25.4mm] from cabinet

Decorative molding and/or water connections extend 1.2 in. [30.5mm] beyond front of cabinet.

Louvered vents in the compressor section right side access panel extend 1/2 in. [12.7 mm] from side of cabinet. Allow clearance for venting.

Units Not Shown Above		L	0
Dight Datum End Dischause	in	2.8	4.6
Right Return End Discharge	cm	7.1	11.8
Dight Datum Cida Disabayas	in	4.9	6.9
Right Return Side Discharge	cm	12.4	17.5
Left Detum End Dischause	in	4.9	7.6
Left Return End Discharge	cm	12.4	19.4
Left Deturn Side Dischause	in	2.8	6.9
Left Return Side Discharge	cm	7.1	17.5

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tage	



Physical Data

Madal			Variable Speed					
Model		036	048	060				
Compressor (1 each)			Variable Speed Scroll					
Factory Charge R-410A, oz [kg] Vertical		95 [2.69]	120 [3.40]	140 [3.96]				
Factory Charge R-410A, oz [kg] Horizontal		95 [2.69]	136 [3.85]	148 [4.19]				
ECM Blower Motor & Blower			,					
Blower Motor Type/Speeds	ECM		Variable Speed					
Blower Motor- hp [W]	ECM	1/2 [373]	1 [746]	1 [746]				
High Static Blower Motor - hp [W]	ECM	1 [746]	n/a	n/a				
Blower Wheel Size (Dia x W), in. [mm]	ECM	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]				
High Static Blower Wheel Size - [Dia. x W], in. [mm]	ECM	11 x 10 [279 x 254]	n/a	n/a				
Coax and Water Piping			,					
Water Connections Size - Swivel - in [mm]		1 [25.4]	1 [25.4]	1 [25.4]				
HWG Connection Size - Female Sweat I.D in [mm]		1/2 [12.7]	1/2 [12.7]	1/2 [12.7]				
Coax & Piping Water Volume - gal [I]		1.6 [6.1]	1.6 [6.1]	2.3 [8.7]				
Vertical								
Air Coil Dimensions (H x W), in. [mm]		32 x 25 [813 x 635]	32 x 25 [813 x 635]	36 x 25 [914 x 635]				
Air Coil Total Face Area, ft² [m²]		5.6 [0.570]	5.6 [0.570]	6.3 [0.641]				
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]				
Air Coil Number of rows		3	3	4				
Filter Standard - 2 in. [51 mm] Pleated MERV 11 Throwaway	, in [mm]	32 x 30 [813 x 762]	32 x 30 [813 x 762]	36 x 30 [914 x 762]				
Weight - Operating, lb [kg]		352 [160]	361 [164]	385 [175]				
Weight - Packaged, lb [kg]		372 [169]	381 [173]	405 [184]				
Horizontal								
Air Coil Dimensions (H x W), in. [mm]		20 x 40 [508 x 1016]	20 x 40 [508 x 1016]	20 x 45 [508 x 1143]				
Air Coil Total Face Area, ft² [m²]		5.6 [0.570]	5.6 [0.570]	6.3 [0.641]				
Air Coil Tube Size, in [mm]		3/8 [9.5]	3/8 [9.5]	3/8 [9.5]				
Air Coil Number of rows		3	3	4				
Filter Standard - 2 in. [51 mm] Pleated MERV 11 Throwaway	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]					
Weight - Operating, lb [kg]		387 [176]	396 [180]	415 [188]				
Weight - Packaged, lb [kg]		417 [189]	426 [193]	445 [202]				

6/1/12

Contractor:	P.O.:	_
Engineer:		_
Project Name:	Unit Tag:	



Auxiliary Heat Ratings

Madal	k'	W	Stamon	Bt	u/h	Min CFM	Model Compatibility				
Model	208V	230V	Stages	208V	230V	MIN CFM	036	048	060		
EAL(H)10*	7.2	9.6	2	24,600	32,700	1100	•	•	•		
EAL(H)15*	10.8	14.4	3	36,900	49,100	1250	•	•	•		
EAL(H)20*	14.4	19.2	4	49,200	65,500	1500		•	•		

Air flow level for auxiliary heat (Aux) must be above the minimum cfm in this table Order the "H" part number when installed on horizontal and vertical rear discharge units

11/30/17

Auxiliary Heat Electrical Data

Model	Supply	Heater Amps		Min Circuit Amp		Max Fuse (USA)		Max Fuse (CAN)		Max CKT BRK	
Model	Circuit	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V
EAL(H)10*	Single	34.7	40	53.3	60	60	60	60	60	60	60
	Single	52.0	60	75	85	80	90	80	90	70	100
EAL(H)15*	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	17.3	20	21.7	25	25	25	25	25	20	30
	Single	69.3	80	96.7	110	100	110	100	110	100	100
EAL(H)20*	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	34.7	40	43.3	50	45	50	45	50	40	50

All heaters rated single phase 60 cycle and include unit fan load All fuses type "D" time delay (or HACR circuit breaker in USA)

11/30/17

Electrical Data

	Datad	V-14	Compressor		Drive		HWG	Fut Lana	Blower	Takal IIInik	Minimum	Max Fuse	
Model	Rated Voltage	Voltage Min/Max	LRA	смсс	LRA	Internal Breaker	Pump FLA	Ext Loop FLA	Motor FLA	Total Unit FLA	Circuit Amp	HACR Breaker	
036	208-230/60/1	187/253	10.2	18.0	22.0	30.0	0.4	5.4	4.0	31.8	37.3	40	
*036	208-230/60/1	187/253	10.2	18.0	22.0	30.0	0.4	5.4	7.0	34.8	40.3	45	
048	208-230/60/1	187/253	12.0	23.5	28.0	35.0	0.4	5.4	7.0	40.8	47.8	50	
060	208-230/60/1	187/253	12.0	30.0	33.0	40.0	0.4	5.4	7.0	45.8	54.1	60	

*With optional 1 hp Variable Speed ECM Motor Rated Voltage of 208/230/60/1 HACR circuit breaker in USA only All fuses Class RK-5 3/26/12

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	





Blower Performance Data

Variable Speed ECM Blower Motor

		Air Flow													
Model	Max ESP	Speed 1	Speed 2	Speed 3	Speed 4	Speed 5	Speed 6	Speed 7	Speed 8	Speed 9	Speed 10	Speed 11	Speed 12		
036	0.50	285	380 G	525 L	675	815	980	1100	1220	1330	1440 H	1540 Aux	1575		
036 w/1hp*	0.75	480	565 G	665 L	761	870	1000	1100	1200	1300	1410 H	1520 Aux	1630		
048	0.75	475	620 G	730 L	850	1020	1140	1270	1400	1520	1650 H	1790 Aux	1925		
060	0.75	400	600 G	830 L	1050	1230	1400	1560	1700	1870	2010 H	2140 Aux	2265		
**VS Compresso	r Speed			1-2	3-4		5-6	7-8		9-10	11-12				

^{**} VS Compressor speed is given for the factory default cfm settings. When the cfm default settings are changed it will change the relationship to the compressor speed that is shown in the table. In cooling mode compressor speeds 10-12 are only available when SuperBoost mode is selected at the thermostat.

6/7/12

Cfm is controlled within 5% up to the maximum ESP

Max ESP includes allowance for wet coil and standard filter

Setting Blower Speed - Variable Speed ECM

The ABC board's Yellow Config LED will flash the current ECM blower speed selections for G, low, and high continuously with a short pause in between. The speeds can also be confirmed with the AID Tool under the Setup/ECM Setup screen. The Aux will not be flashed but can be viewed in the AID Tool. The ECM blower motor speeds can be field adjusted with or without using an AID Tool.

Variable speed ECM Setup without an AID Tool

The blower speeds for G only, Low (Y1), and High (Y2/Aux) can be adjusted directly at the Aurora ABC board which utilizes the push button (SW1) on the ABC board. This procedure is outlined in the ECM Configuration Mode portion of the Aurora 'Base' Control System section. The Aux cannot be set manually without an AID Tool.

Variable speed ECM Setup with an AID Tool

A much easier method utilizes the AID Tool to change the airflow using the procedure below. First navigate to the Setup screen and then select ECM Setup. This screen displays the current ECM settings. It allows the technician to enter the setup screens to change the ECM settings. Change

ECM Speed Info

Blower Only Speed 3
Lo Compressor 6
Hi Compressor 9
Aux Heat 10


Want To Change?

Yes No
Option ◀▶ Enter ■

the highlighted item using the ◀ and ▶ buttons and then press the ■ button to select the item.


Selecting YES will enter ECM speed setup, while selecting NO will return to the previous screen.

ECM Speed Setup - These screens allow the technician to select the G, low, high, and auxiliary heat blower speed for the ECM blower motor. Change the highlighted item using the \blacktriangle and \blacktriangledown buttons. Press the \blacksquare button to select the speed.

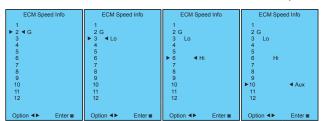

After the auxiliary heat speed setting is selected the AID Tool will automatically transfer back to the ECM Setup screen.

Cooling Airflow Setup - These screens allow the technician to select -15%, -10%, -5%, None or +5% change from the heating airflow. Change the adjustment percentage using the ▲ and ▼ buttons. Press the ■ button to save the change.





^{*} Optional 1 hp Variable Speed ECM

Factory settings are at recommended L , H and Aux positions

[&]quot;G" may be located anywhere within the airflow table

[&]quot;L" setting should be located within the boldface cfm range

[&]quot;H" setting MUST be located within the shaded cfm range

[&]quot;Aux" setting MUST be equal to or greater than "H" setting

[&]quot;Aux" setting MUST be equal to or greater than the minimum allowable cfm for the auxiliary heater kit (see auxiliary heat ratings table)

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	



Operating Limits

On avating Limits	Coo	ling	Hea	ting
Operating Limits	(°F)	(°C)	(°F)	(°C)
Air Limits				
Min. Ambient Air	45	7.2	45	7.2
Rated Ambient Air	80	26.7	70	21.1
Max. Ambient Air	100	37.8	85	29.4
Min. Entering Air	50	10.0	40	4.4
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0
Max. Entering Air db/wb	110/83	43/28.3	80	26.7
Water Limits				
Min. Entering Water	30	-1.1	20	-6.7
Normal Entering Water	50-110	10-43.3	30-70	-1.1
Max. Entering Water	120	48.9	90	32.2

NOTE: Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

Definitions

Abbreviations and Definitions

cfm = airflow, cubic feet/minute

EWT = entering water temperature, Fahrenheit

gpm = water flow in gallons/minute

WPD = water pressure drop, psi and feet of water

EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)

HC = air heating capacity, MBtu/h
TC = total cooling capacity, MBtu/h
SC = sensible cooling capacity, MBtu/h
kW = total power unit input, kilowatts
HR = total heat of rejection, MBtu/h
HE = total heat of extraction, MBtu/h

HWC = hot water generator capacity, MBtu/h

EER = Energy Efficient Ratio

= Btu output/Watt input

COP = Coefficient of Performance

= Btu output/Btu input

LWT = leaving water temperature, °F
LAT = leaving air temperature, °F
TH = total heating capacity, MBtu/h
LC = latent cooling capacity, MBtu/h
S/T = sensible to total cooling ratio

Pressure Drop

Madal			Pres	sure Drop	(psi)		
Model	gpm	30° F	50° F	70°	90° F	110° F	
	11.5	3.40	3.20	3.00	2.80	2.60	
	9.0	2.70	2.60	2.40	2.20	2.10	
36	7.0	1.65	1.55	1.45	1.35	1.25	
	5.5	1.10	1.00	0.90	0.85	0.75	
	4.5	0.68	0.64	0.60	0.55	0.51	
	13.5	4.60	4.40	4.10	3.80	3.50	
	10.5	2.90	2.70	2.50	2.30	2.20	
48	7.5	1.70	1.60	1.50	1.40	1.30	
	6.0	1.20	1.10	1.00	0.96	0.91	
	4.0	0.62	0.61	0.60	0.58	0.56	
	17.0	6.40	6.00	5.60	5.20	4.80	
	13.5	4.10	3.80	3.60	3.30	3.10	
60	9.5	2.20	2.10	2.00	1.80	1.70	
	7.5	1.70	1.60	1.50	1.40	1.30	
	5.0	0.68	0.62	0.58	0.55	0.53	

Notes to Performance Data Tables

The following notes apply to all performance data tables:

- Performance ratings are based on 80°F DB/67°F WB EAT for cooling and 70°F DB EAT for heating.
- Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EWT. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/tower applications.
- The hot water generator numbers are based on a flow rate of 0.4 gpm/ton of rated capacity with an EWT of 90°F.
- Entering water temperatures below 40°F assumes 15% antifreeze solution.
- For non-standard EAT conditions, apply the appropriate Correction Factor tables.
- Interpolation between EWT, gpm, and cfm data is permissible, extrapolation is not.

6/29/12

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





Correction Factor Tables

Air Flow Corrections (Compressor Speeds 1-3)

Air	flow		Coc	oling			Heating	
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.940	0.740	0.967	0.951	0.943	1.106	0.902
275	69	0.950	0.783	0.973	0.959	0.953	1.088	0.918
300	75	0.960	0.827	0.978	0.967	0.962	1.070	0.935
325	81	0.970	0.870	0.984	0.975	0.972	1.053	0.951
350	88	0.980	0.913	0.989	0.984	0.981	1.035	0.967
375	94	0.990	0.957	0.995	0.992	0.991	1.018	0.984
400	100	1.000	1.000	1.000	1.000	1.000	1.000	1.000
425	106	1.030	1.022	1.024	1.026	1.009	0.982	1.016
450	113	1.060	1.045	1.048	1.051	1.019	0.965	1.033
475	119	119 1.091 1.067		1.071	1.077	1.028	0.947	1.049
500	125	1.121 1.089		1.095	1.103	1.038	0.930	1.065
520	130	1.151	1.111	1.110	1.129	1.047	0.912	1.082

6/29/12

Air Flow Corrections (Compressor Speeds 4-12)

Airf	low		Coo	ling			Heating	
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.928	0.747	0.936	0.929	0.961	1.097	0.938
275	69	0.940	0.789	0.946	0.941	0.967	1.081	0.948
300	75	0.952	0.831	0.957	0.953	0.974	1.064	0.959
325	81	0.964	0.873	0.968	0.965	0.980	1.048	0.969
350	88	0.976	0.916	0.979	0.976	0.987	1.032	0.979
375	94	0.988	0.958	0.989	0.988	0.993	1.016	0.990
400	100	1.000	1.000	1.000	1.000	1.000	1.000	1.000
425	106	1.020	1.023	1.004	1.018	1.010	0.966	1.018
450	113	1.056	1.042	1.008	1.035	1.020	0.932	1.036
475	119	1.072	1.079	1.011	1.053	1.029	0.898	1.054
500	125	1.087	1.095	1.095 1.015		1.039	0.865	1.071
520	130	1.099	1.113	1.019	1.088	1.049	0.831	1.089

6/14/12

Cooling Capacity Corrections

Entering	Total Clg			Sensib	le Cooling	Capacity	Multipliers	- Entering	DB °F			Power	Heat of
Air WB °F	Cap	60	65	70	75 80 80.6		85	90	95	100	Input	Rejection	
55	0.898	0.723	0.866	1.048	1.185	*	*	*	*	*	*	0.985	0.913
60	0.912		0.632	0.880	1.078	1.244	1.260	*	*	*	*	0.994	0.927
63	0.945			0.768	0.960	1.150	1.175	*	*	*	*	0.996	0.954
65	0.976			0.694	0.881	1.079	1.085	1.270	*	*	*	0.997	0.972
66.2	0.983			0.655	0.842	1.040	1.060	1.232	*	*	*	0.999	0.986
67	1.000			0.616	0.806	1.000	1.023	1.193	1.330	1.480	*	1.000	1.000
70	1.053				0.693	0.879	0.900	1.075	1.205	1.404	*	1.003	1.044
75	1.168					0.687	0.715	0.875	1.040	1.261	1.476	1.007	1.141

NOTE: *Sensible capacity equals total capacity at conditions shown.

4/22/12

Heating Capacity Corrections

Ent Air DB °F		Heating Correction	ıs		
Ent Air DB 'F	Htg Cap	Power	Heat of Ext		
45	1.062	0.739	1.158		
50	1.050	0.790	1.130		
55	1.037	0.842	1.096		
60	1.025	0.893	1.064		
65	1.012	0.945	1.030		
68	1.005	0.976	1.012		
70	1.000	1.000	1.000		
75	0.987	1.048	0.970		
80	0.975	1.099	0.930		

11/10/09

Contractor:	P.O.:
Engineer:	
Droject Name:	Unit Tag



Antifreeze Corrections

Catalog performance can be corrected for antifreeze use. Please use the following table and note the example given.

Antifreeze Type	Antifreeze % by wt	Heating	Cooling	Pressure Drop
EWT - °F [°C]		30 [-1.1]	90 [32.2]	30 [-1.1]
Water	0	1.000	1.000	1.000
	10	0.973	0.991	1.075
	20	0.943	0.979	1.163
Ethylene Glycol	30	0.917	0.965	1.225
	40	0.890	0.955	1.324
	50	0.865	0.943	1.419
	10	0.958	0.981	1.130
	20	0.913	0.969	1.270
Propylene Glycol	30	0.854	0.950	1.433
	40	0.813	0.937	1.614
	50	0.770	0.922	1.816
	10	0.927	0.991	1.242
	20	0.887	0.972	1.343
Ethanol	30	0.856	0.947	1.383
	40	0.815	0.930	1.523
	50	0.779	0.911	1.639
	10	0.957	0.986	1.127
	20	0.924	0.970	1.197
Methanol	30	0.895	0.951	1.235
	40	0.863	0.936	1.323
	50	0.833	0.920	1.399



WARNING: Gray area represents antifreeze concentrations greater than 35% by weight and should be avoided due to the extreme performance penalty they represent.

Antifreeze Correction Example

Antifreeze solution is Propylene Glycol 20% by weight. Determine the corrected heating and cooling performance at 30°F and 90°F respectively as well as pressure drop at 30°F for a 036 operating at 100% capacity.

The corrected cooling capacity at 90°F would be: 35,200 MBtu/h x 0.969 = 34,109 MBtu/h

The corrected heating capacity at 30°F would be: 37,400 MBtu/h x 0.913 = 34,146 MBtu/h

The corrected pressure drop at 30°F and 11.5 gpm would be: 7.9 feet of head x 1.270 = 10.03 feet of head

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





Performance Data

036 - 50% Part Load

036	36 - 50% Part Load																					
EWT	Flow	WP	D		H	IEATING	G - EAT	70°F			EWT	Flow	WF	D			COOLIN	G - EA	T 80/6	7 °F		
°F	gpm	PSI	FT	Airflow cfm	HC MBtuh	Power kW	HE MBtuh	°F	СОР	HWC MBtuh	°F	gpm	PSI	FT	Airflow cfm	TC MBtuh	SC MBtuh	S/T Ratio	Power kW	HR M Btuh	EER	HWC MBtuh
	3.0 4.5	0.30	0.7 1.6		Oper	ation no	ot recon	nmenc	ded			2.5 3.5	0.15	0.4 1.1								
20	5.5	1.09	2.5	550 750	14.4 14.6	1.24	10.2	94.3 88.1	3.41	2.2	20	5.0	0.77	1.8	Operation not recommended							
	3.0	0.30	0.7	550	16.5	1.30	12.0	97.7	3.71	2.3		2.5	0.15	0.3	500	21.4	14.9	0.70	0.56	23.3	38.3	-
				750 550	16.7 17.3	1.32	12.2 12.7	90.6 99.1	3.69	2.0					650 500	20.9	14.8 14.9	0.71	0.62	23.0	33.9 39.6	-
30	4.5	0.68	1.6	750	17.7	1.35	13.1	91.8	3.84	2.2	30	3.5	0.45	1.0	650	20.7	15.4	0.74	0.65	22.9	31.7	-
	5.5	1.06	2.4	550 750	17.7 17.9	1.35	13.1 13.3	99.7 92.1	3.84	2.7		5.0	0.75	1.7	500 650	21.7 21.0	15.3 15.2	0.71	0.53	23.5	40.7 34.4	-
	3.0	0.29	0.7	550	18.5	1.35	13.9	101.1	4.03	2.5		2.5	0.14	0.3	500	24.8	16.3	0.66	0.66	27.1	37.3	-
				750 550	18.8 19.4	1.36	14.2 14.7	93.2 102.7	4.06	2.2					650 500	24.7 24.8	16.7 16.3	0.67	0.74	27.3 27.0	33.4 38.7	-
40	4.5	0.66	1.5	750	19.8	1.38	15.1	94.5	4.20	2.3	40	3.5	0.44	1.0	650	24.6	17.0	0.69	0.75	27.2	32.8	-
	5.5	1.02	2.4	550 750	19.8 20.1	1.39	15.0 15.4	103.3 94.9	4.15	2.8		5.0	0.73	1.7	500 650	25.1 24.9	16.5 17.0	0.66	0.64	27.3 27.3	39.4 35.1	-
	3.0	0.20	0.6	550	20.5	1.45	15.4	104.6	4.16	2.8		2.5	014	0.7	500	28.4	17.8	0.63	0.71	31.1	36.7	-
	3.0	0.28	0.6	750	0 21.0 1.45 16.0 95.9 4.24 2.3								0.14	0.3	650	28.5	18.5	0.65	0.87	31.5	32.9	-
50	4.5	0.64	1.5	550 750	21.6 22.0	1.48	16.5 16.9	106.3 97.1	4.27	3.0 2.5	50	3.5	0.42	1.0	500 650	28.5 28.5	17.9 18.7	0.63	0.75 0.85	31.0 31.4	38.1 33.5	-
	5.5	0.99	2.3	550	50 21.9 1.50 16.8 106.8 4.27 3.1								0.70	1.6	500	28.8	18.0	0.62	0.74	31.3	38.7	-
				750 550	22.4	1.49	17.3 18.2	97.7 108.8	4.41	2.8 3.0		5.0			650 500	28.8	18.7 16.3	0.65	0.81	31.6 27.0	35.6 29.1	1.0
İ	3.0	0.27	0.6	750	23.5	1.41	18.7	99.1	4.91	2.5		2.5	0.13	0.3	650	24.7	17.3	0.70	0.91	27.8	27.2	1.0
60	4.5	0.62	1.4	550 750	24.1 24.7	1.45	19.2 19.8	110.6 100.5	4.88 5.03	3.2 2.7	60	3.5	0.41	0.9	500 650	24.2 24.8	16.4 17.4	0.68	0.80	27.0 27.8	30.3	1.1
	5.5	0.96	2.2	550	24.5	1.47	19.5	111.3	4.89	3.3		5.0	0.68	1.6	500	24.5	16.5	0.67	0.79	27.2	30.9	1.2
	5.5	0.90	2.2	750	25.1	1.45	20.2	101.0	5.08	2.8		3.0	0.00	1.0	650	25.0	17.5	0.70	0.85	27.9	29.4	1.2
	3.0	0.26	0.6	550 750	25.3 25.9	1.35	20.7	112.6 102.0	5.48 5.54	3.2 2.6		2.5	0.13	0.3	500 650	20.0 18.9	14.8 14.7	0.74	0.88	23.0	22.6	1.3
70	4.5	0.60	1.4	550	26.4	1.38	21.7	114.4	5.61	3.4	70	3.5	0.40	0.9	500	20.1	14.9	0.74	0.85	23.0	23.6	1.4
				750 550	27.2 26.5	1.36	22.6 21.2	103.6 114.6	5.86	2.9 3.5					650 500	21.1 19.9	16.1 14.0	0.76	0.92	24.2	23.0	1.4 1.5
	5.5	0.93	2.1	750	27.6	1.37	22.9	104.1	5.91	2.9		5.0	0.66	1.5	650	21.1	16.3	0.77	0.89	24.1	23.7	1.5
	3.0	0.25	0.6	550 750	27.2 28.0	1.43	22.3	115.8 104.5	5.57 5.88	3.4 2.8		2.5	0.13	0.3	500 650	19.2 19.8	14.6 15.6	0.76	1.05 1.12	22.8	18.3	1.9 2.0
80	4.5	0.57	1.3	550	28.4	1.46	23.4	117.8	5.69	3.6	80	3.5	0.38	0.9	500	19.4	14.7	0.76	1.01	22.8	19.1	2.1
**		0.07		750 550	29.3 28.9	1.43	24.4	106.2 118.6	6.03 5.72	3.0 3.8					650 500	20.0 19.6	15.6 14.8	0.78	1.07	23.6	18.6	2.1
	5.5	0.90	2.1	750	29.8	1.44	24.9	106.8	6.07	3.2		5.0	0.64	1.5	650	20.1	15.7	0.79	1.04	23.6	19.3	2.5
	3.0	0.24	0.6	550	29.1	1.44	24.2	119.0	5.92	3.6		2.5	0.12	0.3	500	18.5	14.3	0.77	1.22	22.7	15.1	2.6
	4.5	0.55	1.7	750 550	30.1 30.4	1.40	25.3 25.3	107.1 121.1	6.31	2.9 3.8			0.77		650 500	18.6 18.6	15.0 14.4	0.81	1.30 1.18	23.0	14.4 15.8	2.6
90	4.5	0.55	1.3	750	31.4	1.42	26.6	108.8	6.47	3.2	90	3.5	0.37	0.9	650	18.8	15.0	0.80	1.23	23.0	15.3	2.7
	5.5	0.87	2.0	550 750	30.8 32.0	1.49	25.7 27.1	121.9 109.5	6.06	4.1 3.4		5.0	0.61	1.4	500 650	18.8 19.0	14.6 15.2	0.78	1.15 1.19	22.7	16.3	2.8
	3.0	0.23	0.5									2.5	0.12	0.3	500	16.6	13.5	0.81	1.39	21.4	11.9	3.1
															650 500	16.8 16.8	14.1 13.6	0.84	1.44	21.7 21.3	11.7 12.6	3.1
100	4.5	0.53	1.2								100	3.5	0.35	0.8	650	16.9	14.2	0.84	1.37	21.6	12.4	3.2
	5.5	0.84	1.9									5.0	0.59	1.4	500 650	16.9 17.1	13.8 14.4	0.81	1.30 1.33	21.4 21.6	13.0	
	3.0	0.22	0.5		Operation not recommended							2.5	0.11	0.3	500	14.7	12.6	0.86	1.56	20.1	9.5	3.0
															650 500	14.9 14.9	13.1 12.8	0.88	1.57 1.49	20.3	9.5	3.0
110	4.5	· · · · · ·						110	3.5	0.34	0.8	650	15.0	13.3	0.89	1.51	20.2	10.0	3.2			
	5.5	0.80	1.9									5.0	0.57	1.3	500 650	15.0 15.2	13.0 13.5	0.86	1.46 1.47	20.0	10.3	
	3.0	0.22	0.5						2.5	0.11	0.2	500	13.2	11.3	0.86	1.81	19.4	7.3	4.3			
												\vdash			650 500	13.0 13.3	11.3 11.5	0.87	1.75 1.74	18.9 19.3	7.4	4.4
120	4.5	0.49	1.1								120	3.5	0.33	0.8	650	13.1	11.7	0.89	1.74	19.0	7.5	4.4
	5.5	0.77	1.8									5.0	0.55	1.3	500 650	13.6 13.3	11.9 11.8	0.88	1.67 1.69	19.3 19.1	8.1 7.9	4.6 4.6
	rmano				n in thou										030	10.0	11.0	0.03	1.05	1 13.1		//70/15

Performance capacities shown in thousands of Btuh.

7/30/1

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	





036 - 100% Full Load

036	- 100	100% Full Load																				
		W	PD		Н	EATING	G - EAT	70°F				<u></u>	WI	PD			COOLI	NG - E	AT 80/6	57 °F		
EWT °F	Flow	DCI		Airflow	нс	Power	HE	LAT	COD	HWC	EWT °F	Flow	DCI		Airflow	TC	sc	S/T	Power	HR	FED	HWC
	gpm	PSI	FT	cfm	MBtuh	kW	MBtuh	°F	СОР	MBtuh	· F	gpm	PSI	FT	cfm	MBtuh	MBtuh	Ratio	kW	MBtuh	EER	MBtuh
	5.5	1.09	2.5		Opera	ation no	ot recom	menc	ded			4.5	0.70	1.6								
20	8.0	2.69	6.2	1150						4.7	20	7.0	1.70	3.9		0	peratio	n not r	ecomm	ended		
	11.5	3.51	8.1	1150 1500	31.6 32.6	2.84	21.9 22.8	95.4	3.26	4.7		9.0	2.81	6.5								
				1150	35.3	2.74	25.9	98.4	i —	5.2					1000	39.2	27.3	0.70	1.08	42.9	36.4	_
	5.5	1.06	2.5	1500	36.0	2.79	26.4	92.2	3.78	4.8		4.5	0.68	1.6	1300	38.5	27.4	0.71	1.21	42.6	31.9	-
30	8.0	2.61	6.0	1150	35.6	2.77	26.1	98.6	_	5.3	30	7.0	1.65	3.8	1000	39.2	27.3	0.70	1.04	42.8	37.6	-
				1500	36.3	2.82	26.7	92.4 99.1	† 	4.8 5.4					1300	38.0	28.1	0.74	1.26 1.05	42.3 42.9	30.1	-
	11.5	3.41	7.9	1150 1500	36.1 37.4	2.92	26.1 27.5	93.1	3.62	5.0		9.0	2.73	6.3	1300	39.3 38.6	27.5 27.8	0.70	1.18	42.9	37.6 32.7	-
		1.00	2.4	1150	40.9	2.73	31.6	103.0	_	5.6		4.5	0.00	1.5	1000	41.5	29.7	0.72	1.23	45.6	33.8	-
	5.5	1.02	2.4	1500	41.5	2.77	32.1	95.6		5.0		4.5	0.66	1.5	1300	41.3	30.4	0.74	1.37	46.0	30.1	-
40	8.0	2.53	5.9	1150	41.3	2.74	32.0	103.3	+	5.8	40	7.0	1.60	3.7	1000	41.5	29.7	0.72	1.18	45.5	35.0	-
				1500 1150	42.3 42.5	2.80	32.8 32.9	96.1 104.2	4.43	5.1 5.9					1300	41.1 41.8	31.0 29.9	0.75	1.39 1.18	45.8 45.8	29.7 35.4	-
	11.5	3.31	7.6	1500	43.3	2.85	33.6	96.7	4.46	5.2		9.0	2.65	6.1	1300	41.6	30.9	0.74	1.31	46.1	31.8	-
		0.00	2.7	1150	46.0	36.2	107.0	_	6.0		4.5	0.64	1.	1000	44.0	32.3	0.73	1.38	48.7	31.9	-	
	5.5	0.99	2.3	1500	46.4	2.88	36.6	98.7	4.72	5.6		4.5	0.64	1.5	1300	44.2	33.6	0.76	1.54	49.4	28.7	-
50	8.0	2.46	5.7	1150	46.4	2.84	36.7 37.7	107.4		6.5 5.7	50	7.0	1.55	3.6	1000	44.1	32.4	0.73	1.33	48.6	33.2	-
								99.4 108.2	 	6.6	"				1300	44.2 44.5	33.9 32.6	0.77	1.51	49.3 49.0	29.2 33.7	-
	11.5	3.20	7.4	1500	48.5	2.94	37.5 38.5	_	4.83	6.8		9.0	2.56	5.9	1300	44.6	33.9	0.76	1.44	49.5	31.0	-
	5.5	0.93	2.2	1150	50.8	2.87	41.0	110.9	5.18	6.1		4.5	0.62	1.4	1000	41.4	31.3	0.76	1.61	46.9	25.7	1.9
	5.5	0.93	2.2	1500	51.6	2.89	41.7	101.9	+	5.7		4.5	0.02	1.4	1300	42.4	33.3	0.78	1.77	48.4	24.0	2.0
60	8.0	2.38	5.5	1150 1500	52.0 52.8	2.88	42.2 42.8	111.9 102.6	5.29	6.7 5.8	60	7.0	1.50	3.5	1000	41.6 42.6	31.5	0.76	1.55 1.71	46.9 48.4	26.8	2.1
				1150	53.2	2.92	43.2	112.8		6.9		_			1000	42.0	33.4 31.7	0.75	1.54	47.2	24.8	2.0
İ	11.5	3.10	7.2	1500	54.3	2.97	44.1	103.5		6.0		9.0	2.48	5.7	1300	42.8	33.6	0.78	1.65	48.4	25.9	2.2
	5.5	0.90	2.1	1150	54.9	2.95	44.8	114.2	_	6.6		4.5	0.60	1.4	1000	38.9	30.3	0.78	1.85	45.2	21.0	2.7
	3.5	0.50	2.1	1500	56.4	3.00	46.2	104.8		6.2		ļ	0.00	17	1300	36.8	29.7	0.81	1.84	43.1	20.0	2.9
70	8.0	2.30	5.3	1150 1500	56.9 57.9	3.02 2.95	46.6 47.8	115.8 105.7	_	6.9 6.4	70	7.0	1.45	3.4	1000	39.1 41.0	30.5 33.0	0.78	1.78 1.92	45.2 47.6	22.0	3.1 3.1
				1150	58.7	3.08	48.2	117.3		7.6		.			1000	40.2	30.3	0.75	1.75	46.1	23.0	3.2
	11.5	3.00	6.9	1500	60.0	3.01	49.7		5.84	6.6		9.0	2.40	5.5	1300	41.0	33.3	0.81	1.86	47.4	22.1	3.3
	5.5	0.87	0.1	1150	60.2	3.15	49.4	118.4	_	7.2		4.5	0.57	1.3	1000	36.6	29.9	0.82	2.16	44.0	16.9	4.0
				1500 1150	61.3 63.0	3.16 3.18	50.5 52.1	107.8 120.7		6.1 7.5		<u> </u>			1300	37.6 36.8	31.9 30.1	0.85	2.30	45.4 43.9	16.3	4.0
80	8.0	2.22	5.1	1500	63.4	3.17	52.6	109.1	5.85	6.3	80	7.0	1.40	3.2	1300	37.9	31.9	0.84	2.19	45.4	17.7	4.2
	11.5	2.90	6.7	1150	63.9	3.23	52.8	121.4	1	7.7		9.0	2.32	5.4	1000	37.2	30.4	0.82	2.04	44.1	18.2	4.4
	11.5	2.90	6.7	1500	65.1	3.25	54.0	110.2	_	7.2		9.0	2.52	5.4	1300	38.1	32.3	0.85	2.13	45.4	17.9	4.4
	5.5	0.84	1.9	1150	64.7	3.35	53.3	122.1	_	7.4		4.5	0.55	1.3	1000	34.2	29.4	0.86	2.47	42.7	13.9	5.3
				1500 1150	65.8 68.2	3.29 3.41	54.5 56.5	110.6 124 9	5.86	6.7 7.8		-			1300	34.5 34.5	30.9 29.7	0.90	2.62	43.4 42.6	13.2	5.3 5.6
90	8.0	2.14	5.0	1500	69.0	3.33	57.6	112.6		7.2	90	7.0	1.35	3.1	1300	34.8	30.9	0.89	2.47	43.3	14.1	5.6
	11.5	2.79	6.5	1150	68.5	3.48	56.6	125.1	5.76	8.6		9.0	2.24	5.2	1000	34.8	30.0	0.86	2.33	42.8	15.0	5.9
	11.0	2.70	0.0	1500	70.3	3.42	58.6	113.4	6.01	7.9		0.0	2.2	J.2	1300	35.2	31.2	0.89	2.40	43.4	14.7	5.6
	5.5	0.80	1.8									4.5	0.53	1.2	1000	32.0 32.2	28.1 29.4	0.88	2.89	41.8 42.4	11.1	6.8 6.7
															1000	32.2	28.4	0.88	2.77	41.7	11.6	7.1
100	8.0	2.07	4.8								100	7.0	1.30	3.0	1300	32.6	29.6	0.91	2.84	42.2	11.5	7.0
	11.5	2.69	6.2									9.0	2.16	5.0	1000	32.6	28.7	0.88	2.71	41.8	12.0	7.5
-															1300	32.9 29.7	29.9 26.7	0.91	2.76 3.31	42.3 41.0	11.9	6.2
	5.5	0.77	1.8										0.51	1.2	1300	30.0	27.8	0.93	3.34	41.4	9.0	8.1 8.0
110	ΩΛ	1.99	16		Operation not recommended 110					110	70	1 25	2.9	1000	30.0	27.1	0.90	3.17	40.8	9.5	8.5	
110	8.0	1.99	4.6		Opera	ation no	recom	menc	ied		110	7.0	1.25	2.9	1300	30.3	28.2	0.93	3.20	41.2	9.5	8.5
	11.5	2.59	6.0									9.0	2.07	4.8	1000	27.8	27.5	0.99	3.09	38.3	9.0	8.9
\vdash	\vdash									\vdash			1300	30.6 28.0	28.6 25.7	0.93	3.12 3.85	41.2 41.1	9.8 7.3	8.1 9.9		
	5.5	0.73	1.7								4.5	0.49	8.0	1300	27.6	26.0	0.95	3.75	40.4	7.3	10.2	
120	8.0	1.91	4.4								120	7.0	1.20	2.8	1000	28.3	26.1	0.92	3.69	40.9	7.7	10.3
	L										120	ļ <u>.</u>	20	2.0	1300	27.7	26.5	0.96	3.70	40.3	7.5	10.5
	11.5	2.49	5.8									9.0	1.99	4.6	1000	28.4	26.6 26.8	0.94	3.59 3.59	40.6 40.4	7.9	10.7
															1300	20.2	∠∪.0	0.95	3.39	40.4		7/70/15

 $\label{performance} \mbox{ Performance capacities shown in thousands of Btuh. }$

7/30/15

Contractor:	P.O.:	_
Engineer:		_
Project Name:	Unit Tag:	





048 - 50% Part Load

048	- 50	<u>% Pa</u>	art	Load																			
		WP	D	HEATING - EAT 70°F									WF	D			COOLI	NG - E	AT 80/	67 °F			
EWT	Flow			Airflow	нс	Power	HE	LAT		HWC	EWT °F	Flow			Airflow	TC	sc	S/T	Power	HR		HWC	
°F	gpm	PSI	FT	cfm	mBtuh		MBtuh	°F	СОР	MBtuh	*F	gpm	PSI	FT			MBtuh		kW	MBtuh	EER	MBtuh	
	3.5	0.56	1.3		_							3.0	0.47	1.1									
	5.0	0.97	2.2		Opera	ation no	t recon	nmend	ded			4.5		1.9	Operation not recommended								
20	<u>с</u> г	1 77	7.0	650	17.6	1.55	12.3	95.0	3.33	2.4	20		110	2.7		C	peratio	n not r	ecomm	nended			
	6.5	1.37	3.2	900	17.8	1.56	12.5	88.3	3.35	3.1		6.0	1.16	2.7									
	3.5	0.55	1.3	650	20.0	1.54	14.8	98.5	3.81	2.7		3.0	0.45	1.1	500	27.9	15.3	0.55	0.56	29.8	49.9	-	
•	3.3	0.55	1.5	900	20.3	1.57	15.0	90.9	_	2.4		3.0	0.43	1	750	27.3	15.2	0.56	0.62	29.4	44.3	_	
30	5.0	0.94	2.2	650	21.0	1.58	15.6		3.90	3.0	30	4.5	0.79	1.8	500	27.8	15.3	0.55	0.54	29.7	51.6		
				900	21.5	1.60	16.0	92.1	3.94	2.6					750	26.9	15.8	0.58	0.65	29.2	41.3		
	6.5	1.33	3.1	650	21.5	1.60	16.0	_	3.94	3.1		6.0	1.12	2.6	500	28.3	17.2	0.61	0.53	30.1	53.0	-	
	\vdash			900 650	21.8 24.0	1.61 1.58	16.3 18.6	92.4	_	2.6 3.0	_				750 500	27.4 29.3	15.6 17.6	0.57	0.61	29.5 31.5	44.9 45.1		
1	3.5	0.53	1.2	900	24.5	1.59	19.0	95.2	_	2.6		3.0	0.44	1.0	750	29.2	17.0	0.60	0.03	31.7	40.3	_	
1				650	25.2	1.62	19.7	106.0	_	3.3					500	29.3	17.6	0.60	0.63	31.5	46.7	_	
40	5.0	0.91	2.1	900	25.7	1.63	20.2	96.5	_	2.8	40	4.5	0.77	1.8	750	29.1	18.3	0.63	0.74	31.6	39.6	_	
i				650	25.7	1.64	20.1	106.6	_	3.4					500	29.7	17.8	0.60	0.62	31.8	47.6	_	
İ	6.5	1.29	3.0	900	26.2	1.64	20.6	96.9		2.8		6.0	1.09	2.5	750	29.4	18.3	0.62	0.70	31.8	42.3	-	
	7	0.51	1.0	650	26.7	1.66	21.1	108.1	4.71	3.3		7.0	0 47	1.0	500	31.0	19.9	0.64	0.75	33.6	41.6	-	
	3.5	0.51	1.2	900	27.3	1.66	21.6	98.1	4.81	2.8		3.0	0.43	1.0	750	31.1	20.7	0.66	0.83	34.0	37.3	_	
50	5.0	0.88	2.0	650	28.1	1.70	22.3	110.0	_	3.6	50	4.5	0.74	1.7	500	31.1	20.0	0.64	0.72	33.6	43.2	_	
30	3.0	0.00	2.0	900	28.6	1.70	22.8	99.4	_	3.0	30	4.5	0.74	1.7	750	31.1	20.9	0.67	0.82	33.9	38.0	_	
1	6.5	1.25	2.9	650	28.5	1.72	22.6	110.6	_	3.8		6.0	1.06	24	500	31.4	20.1	0.64	0.72	33.9	43.9	-	
	0.0	1.20	2.0	900	29.2	1.71	23.3	100.0		3.3		0.0	1.00	2. 1	750	31.5	20.9	0.66	0.78	34.1	40.3	-	
	3.5	0.50	1.1	650	30.4	1.72	24.6	113.4	1	3.7		3.0	0.41	1.0	500	29.0	19.4	0.67	0.93	32.2	31.3	1.2	
	_			900	31.1	1.70	25.3	102.0	_	3.0		_			750	29.7	20.6	0.70	1.02	33.1	29.2	1.2	
60	5.0	0.85	2.0	650 900	31.9 32.7	1.75 1.74	25.9 26.7	115.4	5.32	3.9 3.3	60	4.5	0.72	1.7	500 750	29.1 29.8	19.5 20.7	0.67	0.89	32.2 33.2	32.6 30.2	1.3 1.3	
				650	32.4	1.74	26.3	116.2		4.1		\vdash			500	29.4	19.6	0.70	0.89	32.4	33.2	1.4	
1	6.5	1.21	2.8	900	33.2	1.75	27.2		5.55	3.5		6.0	1.02	2.4	750	30.0	20.9	0.70	0.95	33.2	31.6	1.4	
				650	34.1	1.80	27.9	118.5	_	4.0					500	27.0	19.0	0.70	1.11	30.8	24.3	1.7	
İ	3.5	0.48	1.1	900	33.9	1.79	27.8	104.9	_	3.3	ĺ	3.0	0.40	0.9	750	27.5	20.2	0.74	1.29	31.9	21.3	1.8	
1 70		0.07	1.0	650	35.6	1.83	29.3		5.69	4.3	70	4 -	0.70	1.0	500	27.1	19.1	0.70	1.07	30.8	25.3	1.9	
70	5.0	0.83	1.9	900	36.6	1.81	30.5	107.7	5.94	3.6	/"	4.5	0.70	1.6	750	28.5	20.6	0.72	1.15	32.4	24.7	1.9	
	6.5	1.17	2.7	650	35.6	1.84	29.3	120.7	5.67	4.5		6.0	0.99	2 3	500	26.9	18.0	0.67	1.08	30.6	24.9	1.9	
	0.5	1.17	2.7	900	37.2	1.82	31.0	108.3	_	3.7		0.0	0.55	2.5	750	28.5	20.8	0.73	1.12	32.3	25.4	2.0	
	3.5	0.46	1.1	650	36.4	1.83	30.1	121.8		4.2		3.0	0.39	0.9	500	25.6	18.5	0.72	1.33	30.2	19.2	2.5	
				900	37.4	1.84	31.2		5.96	3.5				-	750	26.3	19.8	0.75	1.42	31.2	18.5	2.5	
80	5.0	0.80	1.8	650	38.0 39.2	1.87 1.88	31.6 32.8	124.1	_	4.5 3.8	80	4.5	0.67	1.6	500 750	25.8 26.6	18.7	0.72	1.28	30.2 31.2	20.1	2.6 2.7	
				900 650	38.6	1.00	32.0	110.4 125.0	_	4.8					500	26.0	19.8 18.9	0.73	1.26	30.3	19.6	2.7	
l	6.5	1.13	2.6	900	39.9	1.90	33.4	111.0	6.15	4.0		6.0	0.96	2.2	750	26.7	20.0	0.72	1.32	31.2	20.7	3.2	
				650	38.7	1.88	32.3	125.2	_	4.5					500	24.2	18.1	0.75	1.55	29.5	15.6	3.4	
İ	3.5	0.45	1.0	900	40.0	1.89	33.6	111.2	6.20	3.7		3.0	0.37	0.9	750	24.4	19.1	0.78	1.65	30.0	14.8	3.4	
	- ~	^ 77	1.0	650	40.4	1.92	33.9	127.6	_	4.8		4.5	0.05	1.5	500	24.4	18.3	0.75	1.49	29.5	16.4	3.5	
90	5.0	0.77	1.8	900	41.8	1.93	35.3	113.0	6.36	4.0	90	4.5	0.65	1.5	750	24.7	19.1	0.77	1.56	30.0	15.8	3.6	
	6.5	1.09	2.5	650	41.1	1.97	34.3	128.5	6.11	5.2		6.0	0.92	2.1	500	24.7	18.5	0.75	1.46	29.6	16.8	3.7	
<u> </u>	0.5	1.03	2.5	900	42.6	1.95	35.9	113.8	6.40	4.3		0.0	0.52	۲.۱	750	24.9	19.3	0.77	1.51	30.1	16.5	3.7	
	3.5	0.43	1.0									3.0	0.36	0.8	500	22.8	17.7	0.77	1.86	29.2	12.3	4.3	
	<u> </u>													1	750	23.0	18.5	0.80	1.92	29.6	12.0	4.3	
100	5.0	0.74	1.7								100	4.5	0.62	1.4	500	23.0	17.9	0.78	1.79	29.1	12.9	4.4	
												\vdash			750 500	23.3	18.6 18.1	0.80	1.83 1.75	29.5 29.2	12.7	4.4 4.6	
1	6.5	1.05	2.4									6.0	0.89	2.1	750	23.5	18.8	0.80	1.78	29.6	13.3	4.6	
															500	21.4	17.2	0.80	2.17	28.8	9.9	5.0	
	3.5	0.41	1.0									3.0	0.35	0.8	750	21.7	17.9	0.83	2.19	29.1	9.9	5.0	
			1.0		0				1. 2			4 -	0.00	1.	500	21.7	17.4	0.81	2.08	28.8	10.4	5.4	
110	5.0	0.71	1.6		Opera	ation no	t recon	nmend	ded		110	4.5	0.60	1.4	750	21.9	18.2	0.83	2.10	29.1	10.4	5.4	
	6.5	1.01	2.3									6.0	0.86	20	500	21.9	17.7	0.81	2.03	28.8	10.8	5.8	
	0.5	1.01	2.3									0.0	0.00	2.0	750	22.1	18.4	0.83	2.05	29.1	10.8	5.8	
	3.5	0.40	0.9									3.0	0.33	0.8	500	19.7	16.0	0.81	2.63	28.7	7.5	6.4	
	J.5	J. 70	0.5									L	0.55	0.0	750	19.4	16.0	0.83	2.53	28.1	7.7	6.5	
120	5.0	0.68	1.6								120	4.5	0.58	1.3	500	20.0	16.2	0.81	2.52	28.5	7.9	6.6	
	\vdash												<u> </u>	_	750	19.6	16.5	0.85	2.52	28.2	7.7	6.6	
	6.5	0.97	2.2									6.0	0.82	1.9	500 750	20.3 19.9	16.9 16.7	0.83	2.42	28.6 28.3	8.4	6.8	
			1												/50	19.9	10./	J U.84	2.45	∠d.5	O.I	6.8	

Performance capacities shown in thousands of Btuh.

7/30/15

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





048 - 100% Full Load

048	- 10	<u>0%</u>	<u>rui</u>	l Load																			
		WPD HEATING - EAT 70°F					__/T		WPD COOLING - E							AT 80/67 °F							
EWT °F	gpm	DCI		Airflow	нс	Power	HE	LAT	COD	HWC	°F	Flow	DCI	FT	Airflow	TC	sc	S/T	Power	HR	FED	HWC	
_ '	gpiii	PSI	FT	cfm	mBtuh	kW	MBtuh	°F	СОР	MBtuh		gpiii	PSI	FI	cfm	MBtuh	MBtuh	Ratio	kW	MBtuh	EER	MBtuh	
	6.5	1.40	3.2		Opera	ation no	ot recon	nmend	ded			5.5		2.4									
20	10.0	2.85	6.6	1500						6.05	20	8.0	2.00	4.6	Operation not recommended								
	13.5	4.79	11.1	1500 1800	40.6 41.6	3.67	28.1	95.1 91.4	3.24	6.05 5.6		10.5	2.94	6.8									
				1500	44.9	3.86	31.7	97.7	3.41	6.6					1000	52.6	36.3	0.69	1.33	57.1	39.7	_	
İ	6.5	1.36	3.2	1800	45.8	3.93	32.4	93.5	3.41	6.1		5.5	1.02	2.4	1400	51.5	36.3	0.70	1.48	56.6	34.8	-	
30	10.0	2.77	6.4	1500	45.3	3.90	32.0	98.0	3.40	6.8	30	8.0	1.94	4.5	1000	52.5	36.2	0.69	1.28	56.9	41.0	-	
	10.0		0. 1	1800	46.2	3.97	32.6	93.8	3.41	6.1				1.0	1400	50.9	37.3	0.73	1.55	56.1	32.8	-	
	13.5	4.65	10.7	1500 1800	45.9 47.6	4.11	31.9 33.7	98.4 94.5	3.27	6.9 6.3		10.5	2.85	6.6	1000 1400	52.7 51.7	36.5 36.9	0.69	1.29 1.45	57.1 56.6	41.0 35.7	-	
				1500	49.7	3.94	36.3	100.7	3.70	7.0					1000	54.4	37.4	0.69	1.56	59.7	34.9	_	
	6.5	1.32	3.1	1800	50.4	4.00	36.8	95.9	3.70	6.2		5.5	0.99	2.3	1400	54.3	38.3	0.71	1.75	60.2	31.1	_	
40	10.0	2.69	6.2	1500	50.2	3.95	36.7	101.0	3.72	7.3	40	8.0	1.88	4.3	1000	54.5	37.4	0.69	1.50	59.6	36.2	-	
40	10.0	2.09	0.2	1800	51.4	4.04	37.6	96.4	3.73	6.4	40	0.0	1.00	4.3	1400	54.0	39.0	0.72	1.76	60.0	30.6	_	
	13.5	4.51	10.4	1500	51.6	4.04	37.8	101.8	_	7.5		10.5	2.77	6.4	1000	54.9	37.6	0.69	1.50	60.0	36.5	_	
			_	1800 1500	52.6 58.0	4.11	38.6 44.2	97.1 105.8	3.75 4.20	6.5 7.5					1400	54.6 56.7	38.9 38.9	0.71	1.67 1.80	60.3 62.9	32.8 31.5	-	
	6.5	1.28	3.0	1800	58.6	4.04	44.6	100.1	4.20	7.0		5.5	0.96	2.2	1400	56.9	40.4	0.03	2.01	63.8	28.3	_	
	10.0	2.60		1500	58.6	4.03	44.8	106.2		8.2			1.00	4.0	1000	56.9	39.0	0.69	1.73	62.8	32.8	-	
50	10.0	2.60	6.0	1800	60.1	4.13	46.0	100.9	4.27	7.2	50	8.0	1.82	4.2	1400	56.9	40.8	0.72	1.97	63.7	28.8	-	
	13.5	4.37	10.1	1500	59.9	4.16	45.7	107.0		8.4		10.5	2.68	6.2	1000	57.4	39.2	0.68	1.72	63.3	33.3	-	
				1800	61.2	4.17	47.0	101.5	4.30	8.6					1400	57.5	40.8	0.71	1.88	63.9	30.6	-	
	6.5	1.24	2.9	1500 1800	63.2 64.2	3.99 4.03	49.6 50.5	109.0 103.0		7.6 7.1		5.5	0.93	2.2	1000	52.7 53.9	36.9 39.2	0.70	2.11	60.0 61.8	24.9	2.6 2.8	
				1500	64.7	4.01	51.0	110.0	4.73	8.4					1000	52.9	37.1	0.70	2.04	59.9	26.0	2.9	
60	10.0	2.52	5.8	1800	65.7	4.07	51.8	103.8		7.2	60	8.0	1.76	4.1	1400	54.2	39.4	0.73	2.25	61.9	24.1	2.9	
	13.5	4.23	9.8	1500	66.2	4.08	52.2	110.8	4.75	8.6		10.5	2.60	6.0	1000	53.5	37.3	0.70	2.02	60.3	26.5	2.8	
	15.5	7.23	3.0	1800	67.5	4.13	53.4	104.7	4.79	7.4		10.5	2.00	0.0	1400	54.5	39.6	0.73	2.17	61.9	25.2	3.0	
	6.5	1.20	2.8	1500 1800	67.6 68.3	4.02 3.94	53.9 54.9	111.7	4.93 5.08	8.1 7.5		5.5	0.90	2.1	1000 1400	48.8 47.6	35.0 34.4	0.72	2.44	57.1 56.2	20.0 18.9	3.4 3.7	
				1500	71.3	4.00	57.7	114.0	5.23	8.6					1000	49.0	35.2	0.72	2.34	57.0	20.9	3.9	
70	10.0	2.44	5.6	1800	71.6	4.02	57.9	106.9		7.9	70	8.0	1.71	3.9	1400	51.5	38.0	0.74	2.52	60.1	20.4	3.9	
	13.5	4.00	9.5	1500	72.6	4.61	56.9	114.8	4.62	9.4		10.5	2.51	5.8	1000	50.4	34.9	0.69	2.30	58.3	21.9	3.9	
	13.5	4.09	9.5	1800	74.3	4.10	60.3	108.2		8.2		10.5	2.51	5.0	1400	51.5	38.4	0.75	2.45	59.8	21.0	4.1	
	6.5	1.16	2.7	1500	74.9	4.01	61.3	116.3	5.48	9.0		5.5	0.87	2.0	1000	45.8	34.2	0.75	2.84	55.5	16.1	5.4	
	\vdash			1800 1500	76.3 78.3	4.01	62.6 64.4	109.3 118.3	5.57 5.63	7.7 9.5		_			1400	47.0 46.1	36.6 34.5	0.78	3.03 2.73	57.3 55.4	15.5 16.9	5.4 5.7	
80	10.0	2.35	5.4	1800	79.0	4.03	65.2	110.6	5.74	7.9	80	8.0	1.65	3.8	1400	47.5	36.6	0.73	2.88	57.3	16.5	5.7	
	17.5	7.05	0.1	1500	79.6	4.13	65.5	119.1	5.65	9.6		10.5	0.40		1000	46.5	34.8	0.75	2.68	55.7	17.3	5.9	
	13.5	3.95	9.1	1800	81.1	4.16	67.0	111.7	5.72	9.0		10.5	2.42	5.6	1400	47.7	37.0	0.77	2.80	57.2	17.0	5.9	
	6.5	1.12	2.6	1500	81.0	4.04	67.3	120.0		9.7		5.5	0.84	19	1000	42.7	33.4	0.78	3.24	53.8	13.2	6.7	
				1800	82.3	4.03	68.6	112.4	5.99	8.6					1400	43.0	35.1	0.82	3.43	54.7	12.5	6.6	
90	10.0	2.27	5.2	1500 1800	85.3 86.3	4.13	71.2 72.6	122.7 114.4	6.05	9.5 8.9	90	8.0	1.59	3.7	1000 1400	43.0 43.5	33.7 35.1	0.78	3.11 3.24	53.6 54.5	13.8	7.0 7.0	
				1500	85.7	4.35	70.9	122.9	5.77	10.4					1000	43.5	34.1	0.78	3.06	53.9	14.2	7.3	
	13.5	3.81	8.8	1800	88.0	4.20	73.7	115.3	6.14	9.7		10.5	2.34	5.4	1400	43.9	35.5	0.81	3.15	54.6	13.9	7.4	
	6.5	1.08	2.5									5.5	0.81	1.9	1000	40.8	32.5	0.80	3.78	53.7	10.8	8.9	
	0.5	1.00	2.5									J.5	0.01	1.5	1400	41.1	34.1	0.83	3.90	54.4	10.5	8.8	
100	10.0	2.19	5.1								100	8.0	1.53	3.5	1000 1400	41.1 41.5	32.9 34.3	0.80	3.63 3.71	53.5 54.2	11.3	9.3 9.2	
	\vdash														1000	41.5	33.3	0.80	3.55	53.6	11.7	9.8	
	13.5	3.67	8.5									10.5	2.25	5.2	1400	42.0	34.7	0.83	3.62	54.3	11.6	8.2	
	6.5	1.04	2.4									5.5	0.78	1Ω	1000	38.8	31.7	0.82	4.32	53.6	9.0	10.6	
	0.5	1.04	2.4									3.3	0.78	1.0	1400	39.2	33.0	0.84	4.37	54.1	9.0	10.5	
110	10.0	2.11	4.9		Opera	ation no	ot recon	nmend	ded		110	8.0	1.47	3.4	1000	39.2	32.1	0.82	4.14	53.3	9.5	11.1	
	\vdash											<u> </u>			1400 1000	39.6 39.6	33.5 32.5	0.85	4.18 4.04	53.9 53.4	9.5	11.1 11.6	
	13.5	3.53	8.2									10.5	2.17	5.0	1400	40.0	33.9	0.82	4.04	53.4	9.8	10.5	
		100	2.7										0.75	17	1000	36.1	29.1	0.80	5.02	53.2	7.2	12.8	
	6.5	1.00	2.3									5.5	0.75	1./	1400	35.6	29.5	0.83	4.89	52.3	7.3	13.1	
120	10.0	2.02	4.7								120	8.0	1.42	3.3	1000	36.5	29.5	0.81	4.81	52.9	7.6	13.2	
			<u></u>								'20		<u> </u>	-	1400	35.8	30.1	0.84	4.82	52.2	7.4	13.6	
	13.5	3.39	7.8									10.5	2.08	4.8	1000 1400	36.6 36.4	30.1 30.4	0.82	4.68 4.68	52.6 52.4	7.8 7.8	13.8 14.0	
															1400	30.4	JU.4	0.03	4.00	52.4	7.0	14.0	

Performance capacities shown in thousands of Btuh.

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





060 - 50% Part Load

060	- 50	0% Part Load																				
EWT	Flow	W	PD		HI	EATING	- EAT	70°F			EWT	Flow	WF	D			COOLII	NG - EA	T 80/6	7 °F		
°F	gpm	PSI	FT	Airflow	нс	Power	HE	LAT	СОР	HWC	°F	gpm	PSI	FT	Airflow	TC	sc	S/T	Power	HR	EER	HWC
<u> </u>	gpiii	F 31	۲.	cfm	mBtuh	kW	MBtuh	°F	COF	MBtuh		gpiii	F 31	٠.	cfm	MBtuh	MBtuh	Ratio	kW	MBtuh	LLK	MBtuh
	4.5	0.63			Opera	ition no	t recor	nmen	ded			4.0	0.43									
20	6.3	1.17	2.7	050	•				,	7.4	20	6.0	1.22	2.8		0	peratio	n not re	ecomme	ended		
	8.5	1.94	4.5	850 1100	22.5 23.3	2.18	15.0 15.9	89.6	3.02	3.4 3.1		7.5	1.80	4.2								
				850	26.0	2.15	18.7	98.3	_	3.9					700	36.8	21.4	0.58	0.74	39.3	49.7	_
	4.5	0.61	1.4	1100	26.5	2.18	19.1		3.56	3.4		4.0	0.42	1.0	950	35.6	21.4	0.60	0.83	38.5	42.7	-
30	6.3	1.14	26	850	26.3	2.17	18.9	98.6	3.55	4.1	30	6.0	110	2.7	700	36.8	21.4	0.58	0.72	39.2	51.4	-
30	0.3	1.14	2.6	1100	26.8	2.21	19.2	92.5	3.56	3.5	30	6.0	1.18	2.7	950	35.6	22.0	0.62	0.87	38.6	41.1	-
	8.5	1.89	4.4	850	26.6	2.29	18.8	99.0	_	4.2		7.5	1.75	4.0	700	37.5	22.6	0.60	0.70	39.9	53.2	_
				1100	27.6	2.26	19.9	93.2	3.57	3.6		-			950	36.2	21.8	0.60	0.81	39.0	44.7	-
	4.5	0.60	1.4	850 1100	30.9 31.4	2.22	23.3		4.08	4.3 3.7		4.0	0.41	0.9	700 950	37.3 37.0	23.1 23.7	0.62	0.88	40.3	42.4 37.5	
				850	31.2	2.23	23.6	104.0	+	4.5					700	37.3	23.1	0.62	0.85	40.2	43.9	_
40	6.3	1.10	2.5	1100	32.0	2.28	24.2	96.9	4.11	3.8	40	6.0	1.15	2.6	950	37.0	24.1	0.65	0.99	40.4	37.2	-
	8.5	1.83	4.2	850	32.1	2.28	24.3	105.0	4.12	4.7		7.5	1.70	3.9	700	37.8	23.6	0.63	0.84	40.7	44.9	_
	0.5	1.03	4.2	1100	32.7	2.32	24.8	97.5	4.14	3.9		7.3	1.70	3.9	950	37.4	24.0	0.64	0.94	40.6	39.8	_
	4.5	0.58	1.3	850	35.2	2.34	27.2	108.3	_	4.7		4.0	0.40	0.9	700	38.1	25.0	0.66	1.02	41.6	37.2	_
	\vdash			1100 850	35.5 35.5	2.36	27.4 27.6		4.40	3.9 4.9		-			950 700	38.2 38.2	26.0 25.1	0.68	1.14 0.99	42.1 41.5	33.4 38.7	-
50	6.3	1.07	2.5	1100	36.4	2.39	28.3	_	4.47	4.9	50	6.0	1.11	2.6	950	38.2	26.3	0.69	1.12	42.0	34.0	_
	0.5		4.1	850	36.3	2.41	28.1	_	4.42	5.2			1.04	7.0	700	38.5	25.2	0.65	0.98	41.9	39.3	-
	8.5	1.77	4.1	1100	37.1	2.41	28.9	101.2	_	4.6		7.5	1.64	3.8	950	38.6	26.3	0.68	1.07	42.3	36.1	-
	4.5	0.56	1.3	850	39.3	2.33	31.3	_	4.94	5.1		4.0	0.38	0.9	700	37.2	25.7	0.69	1.31	41.7	28.4	1.5
		0.50	1.0	1100	39.9	2.35	31.9	_	4.98	4.2			0.00		950	38.1	27.3	0.72	1.43	43.0	26.5	1.6
60	6.3	1.03	2.4	850	40.2	2.34	32.2		5.03	5.3	60	6.0	1.08	2.5	700	37.3	25.8	0.69	1.26	41.6	29.6	1.7
				1100 850	40.8 41.1	2.37	32.7 33.0	104.3	5.04	4.5 5.6					950 700	38.3 37.7	27.4 26.0	0.72	1.39 1.25	43.0 42.0	27.5 30.2	1.7 1.8
	8.5	1.72	4.0	1100	41.9	2.41	33.7	105.3	_	4.7		7.5	1.59	3.7	950	38.5	27.6	0.72	1.34	43.0	28.7	1.8
	4.5	0.54	1.0	850	42.7	2.33	34.7		5.36	5.4		10	0.77	0.0	700	36.3	26.3	0.73	1.60	41.8	22.7	2.1
	4.5	0.54	1.2	1100	44.8	2.40	36.6	107.7	5.47	4.5		4.0	0.37	0.9	950	38.9	28.4	0.73	1.77	45.0	22.0	2.3
70	6.3	1.00	2.3	850	43.3	2.39	35.1	117.2	5.31	5.8	70	6.0	1.04	2.4	700	36.5	26.5	0.73	1.54	41.7	23.7	2.4
				1100	45.2	2.33	37.3		5.68	4.8		-			950	38.3	28.6	0.75	1.66	44.0	23.1	2.4
	8.5	1.66	3.8	850 1100	44.8 46.9	2.44	36.5 38.8	118.8	5.38	6.0 5.0		7.5	1.54	3.6	700 950	36.0 38.3	23.1 28.9	0.64	1.58 1.61	41.4	23.8	2.5 2.5
				850	46.8	2.36	38.8	121.0	_	5.8					700	35.5	27.0	0.76	1.83	41.7	19.3	3.1
	4.5	0.52	1.2	1100	47.7	2.36	39.6	110.1	5.91	4.8		4.0	0.36	0.8	950	36.4	28.9	0.79	1.96	43.1	18.6	3.2
80	6.3	0.97	2.2	850	48.9	2.40	40.7		5.97	6.2	80	6.0	1.00	23	700	35.7	27.2	0.76	1.76	41.7	20.2	3.3
**	0.0	0.07		1100	49.2	2.39	41.0	111.4	6.03	5.1	••				950	36.8	28.9	0.78	1.86	43.1	19.7	3.4
	8.5	1.60	3.7	850 1100	49.7 50.7	2.43	41.4	1124.2	5.99 6.06	6.6 5.4		7.5	1.49	3.4	700 950	36.0 37.0	27.4 29.2	0.76	1.74 1.81	42.0 43.1	20.8	3.5 4.0
				850	50.4	2.41	42.1	124.9	_	6.2					700	34.6	27.7	0.80	2.07	41.7	16.7	4.4
l	4.5	0.50	1.2	1100	51.2	2.38	43.1	113.1	6.31	5.0		4.0	0.34	0.8	950	34.9	29.1	0.83	2.19	42.4	15.9	4.4
90	6.3	0.93	2.2	850	52.5	2.48	44.0	127.2	6.20	6.6	90	6.0	0.97	2.2	700	34.9	27.9	0.80	1.99	41.7	17.6	4.6
"	0.5	0.55	2.2	1100	53.1	2.42	44.8	114.7		5.4	50	0.0	0.57	2.2	950	35.2	29.1	0.83	2.07	42.3	17.0	4.6
	8.5	1.55	3.6	850 1100	53.3 54.7	2.51	44.7	128.0	6.22	7.1 5.8		7.5	1.43	3.3	700 950	35.2	28.2	0.80	1.95 2.01	41.9	18.1	4.8 4.8
_	Н			1100	54.7	2.47	40.3	1116.0	10.40	5.6		 			700	35.6 30.7	29.4 25.0	0.83	2.42	38.9	12.7	5.4
	4.5	0.48	1.1									4.0	0.33	0.8	950	31.0	26.2	0.85	2.49	39.5	12.4	5.4
100	6.3	0.00	21								100	6.0	0.93	2.2	700	31.0	25.3	0.82	2.32	38.9	13.4	5.5
100	0.5	0.90	2.1								100	0.0	0.93	2.2	950	31.3	26.4	0.84	2.37	39.4	13.2	5.5
	8.5	1.49	3.4									7.5	1.38	3.2	700	31.3	25.6	0.82	2.27	39.0	13.8	5.8
-	Н														950 700	31.6 26.8	26.7 22.3	0.84	2.31	39.5 36.2	13.7 9.7	5.8 6.3
	4.5	0.47	1.1									4.0	0.32	0.7	950	27.0	23.3	0.86	2.79	36.6	9.7	6.3
110	C 7	0.00	20		0				اء ما		110	60	0.00	2.1	700	27.1	22.7	0.84	2.65	36.1	10.2	6.8
110	0.5	0.86	2.0		Opera	ition no	recor	nmen	ued		110	6.0	0.90	∠.1	950	27.3	23.6	0.86	2.68	36.5	10.2	6.8
	8.5	1.43	3.3									7.5	1.33	3.1	700	27.3	22.9	0.84	2.58	36.1	10.6	7.2
	\vdash											<u> </u>			950	27.6	23.9	0.87	2.61	36.5		7.2
	4.5	0.45	1.0									4.0	0.31	0.7	700 950	25.1 24.4	21.9 22.2	0.87	3.31 3.24	36.4 35.5	7.6	8.2 8.2
		0.6=	1.0								100		0.00	2 2	700	25.4	22.3	0.88	3.16	36.2	8.0	8.4
120	6.3	0.83	1.9								120	6.0	0.86	2.0	950	24.9	22.7	0.91	3.17	35.7	7.8	8.4
	8.5	1.38	3.2									7.5	1.28	3.0	700	25.9	23.8	0.92	3.03	36.2	8.5	8.7
	\Box														950	25.3	22.9	0.91	3.08	35.8	8.2	8.7
D =£ =				as showr	and the same																	7/30/1

Performance capacities shown in thousands of Btuh.

7/30/1

Contractor:	P.O.:	_
Engineer:		_
Project Name:	Unit Tag:	





060 - 100% Full Load

000	- 10			II Load										D COOLING - EAT 80/67 °F								
EWT	Flow	WI	PD	A logi con			- EAT 7			1046	EWT	Flow	W	PD	A luctions							11146
°F	gpm	PSI	FT	Airflow cfm	HC mBtuh	Power kW	HE MBtuh	°F	СОР	HWC MBtuh	°F	gpm	PSI	FT	Airflow	TC MRtub	SC MBtuh	S/T Ratio	Power kW	HR MBtuh	EER	HWC MBtuh
	8.5	2.00	4.6	CIIII						MBtull		6.5	1.21	2.8	Cilii	MBtull	MBtull	Katio	KVV	MBtull		MBtull
20	13.0	3.52	8.1		Opera	ition no	t recom	mend	ed		20	10.0	2.70			0	poration	not ro	commo	andad		
20	17.0	6.55	15.1	1800	51.4	5.23	33.6		2.88	8.1	20	13.5	4.20	9.7		O	peration	i not re	COMMI	enaea		
-	.,,,	0.00		2200	52.4	5.27	34.4	92.1	2.91	7.5		10.0		0.7	1500	60.5	16.4	0.67	205	76.5	740	
	8.5	1.95	4.5	1800 2200	56.8 57.9	5.07 5.16	39.5 40.3	99.2 94.4	3.28 3.29	8.4 7.8		6.5	1.17	2.7	1500 1800	69.5 68.1	46.4 46.4	0.67	2.05	76.5 76.0	34.0 29.8	-
	17.0	7.40	7.0	1800	57.3	5.12	39.8	99.5	3.28	8.6		10.0	0.00		1500	69.5	46.3	0.67	1.98	76.3	35.1	-
30	13.0	3.42	7.9	2200	58.4	5.21	40.6	94.6	3.28	7.9	30	10.0	2.62	6.1	1800	67.3	47.7	0.71	2.40	75.5	28.1	-
	17.0	6.36	14.7	1800	58.1	5.40	39.7	99.9	3.15	8.8		13.5	4.08	9.4	1500	69.7	46.7	0.67	1.99	76.5	35.1	-
_				2200	60.2	5.35	42.0	95.3	3.30	8.0					1800	68.4	47.2	0.69	2.24	76.0	30.5	-
	8.5	1.90	4.4	1800 2200	64.8 65.7	5.16 5.24	47.2 47.8	103.3 97.7	3.68 3.68	8.9 8.2		6.5	1.14	2.6	1500 1800	68.7 68.5	46.4 47.6	0.68	2.32	76.6 77.4	29.7 26.4	_
1,0	17.0	7.70		1800	65.4	5.18	47.7	103.7	3.70	9.2	40	10.0	0.55		1500	68.8	46.4	0.68	2.24	76.4	30.7	-
40	13.0	3.32	7.7	2200	66.9	5.29	48.9	98.2	3.71	8.4	40	10.0	2.55	5.9	1800	68.2	48.4	0.71	2.62	77.1	26.0	-
	17.0	6.17	14.3	1800	67.2	5.30	†	104.6		9.5		13.5	3.96	9.1	1500	69.3	46.7	0.67	2.23	76.9	31.0	-
_				2200	68.5	5.38	50.2	98.8	3.73	8.6					1800	69.0	48.3	0.70	2.48	77.4	27.9	_
	8.5	1.85	4.3	1800 2200	72.2 72.9	5.28 5.34	54.2 54.7	107.1 100.7	4.01	9.5 8.6		6.5	1.10	2.5	1500 1800	68.6 68.8	47.0 48.8	0.69	2.59	77.4	26.5 23.7	_
	17.0	7.01		1800	73.0	5.27	55.0	107.5		9.9		10.0	0.47		1500	68.7	47.1	0.69	2.50	77.2	27.5	-
50	13.0	3.21	7.4	2200	74.9	5.39	56.4	101.5	4.07	8.9	50	10.0	2.47	5.7	1800	68.8	49.3	0.72	2.85	78.5	24.2	-
	17.0	5.98	13.8	1800	74.6	5.44		108.4	1	10.3		13.5	3.83	8.9	1500	69.4	47.4	0.68	2.49	77.9	27.9	-
				2200	76.2	5.45	57.6	102.1	4.10	9.3					1800	69.5	49.3	0.71	2.71	78.7	25.6	71
	8.5	1.80	4.2	1800 2200	80.8 82.1	5.43 5.47	62.3	111.6 104.6	4.37	10.1 9.0		6.5	1.07	2.5	1500 1800	64.4 65.8	45.6 48.4	0.71	2.96 3.24	74.4 76.9	21.8	3.1 3.1
	17.0	7.11	7.0	1800	82.8	5.45	64.2		4.45	10.6		10.0	0.70		1500	64.6	45.7	0.71	2.85	74.3	22.7	2.9
60	13.0	3.11	7.2	2200	84.0	5.53	65.1	105.3	4.45	9.5	60	10.0	2.39	5.5	1800	66.2	48.6	0.73	3.14	76.9	21.0	2.9
	17.0	5.79	13.4	1800	84.6	5.55	65.7	113.5	4.47	11.1		13.5	3.71	8.6	1500	65.2	46.0	0.71	2.82	74.9	23.1	2.7
				2200	86.4	5.61 5.68	67.2	106.3 115.5	4.51 4.56	9.9			-		1800	66.5	48.9	0.73	3.03	76.8 71.5	22.0 18.1	2.7 4.6
	8.5	1.75	4.0	1800 2200	88.4 89.9	5.63	69.0 70.7	107.8		10.6 9.5		6.5	1.03	2.4	1500 1800	60.2 62.7	44.1 47.2	0.73	3.74	75.5	16.8	4.6
	17.0	7.01	7.0	1800	93.2	5.65	73.9	117.9	4.83	11.2		10.0	0.71		1500	60.5	44.4	0.73	3.20	71.4	18.9	4.3
70	13.0	3.01	7.0	2200	93.6	5.68	74.2	109.4	4.83	10.0	70	10.0	2.31	5.3	1800	63.5	47.9	0.75	3.44	75.2	18.5	4.3
	17.0	5.60	12.9	1800	95.0	5.91	74.8	118.8	4.71	11.9		13.5	3.59	8.3	1500	62.2	44.0	0.71	3.14	72.9	19.8	4.2
				2200	97.1 97.6	5.80 5.74	77.3 78.0	110.9 120.2	4.91	10.6					1800	63.5 57.2	48.4 43.2	0.76	3.34	74.9	19.0 14.8	4.1 6.1
	8.5	1.68	3.9	1800 2200	99.4	5.75	79.8	111.8	4.98 5.06	11.8 9.9		6.5	0.99	2.3	1500 1800	58.7	46.2	0.76	4.13	72.8	14.0	6.1
	17.0	2.01	C 7	1800	102.0	5.84	82.1	122.5	_	12.2		10.0	2 27	F 2	1500	57.5	43.5	0.76	3.72	70.2	15.5	5.8
80	13.0	2.91	6.7	2200	102.9	5.78	83.2	113.3	5.21	10.6	80	10.0	2.23	5.2	1800	59.3	46.2	0.78	3.93	72.7	15.1	5.8
	17.0	5.41	12.5	1800	103.7	6.02	83.1	123.3		12.6		13.5	3.47	8.0	1500	58.1	43.9	0.76	3.66	70.6	15.9	5.5
				2200 1800	105.7	5.96 5.99	85.4 85.9	114.5 124.7	_	11.2 11.7			\vdash		1800 1500	59.6 54.1	46.7 42.2	0.78	3.82 4.43	72.6 69.2	15.6 12.2	5.5 8.2
	8.5	1.60	3.7	2200	108.1	5.93	87.8	115.5	5.34	10.3		6.5	0.96	2.2	1800	54.5	44.5	0.78	4.69	70.5	11.6	8.2
90	13.0	2.80	6.5	1800	112.0	6.08	91.2	127.6	5.40	12.6	90	10.0	2.15	5.0	1500	54.5	42.7	0.78	4.25	69.0	12.8	7.8
90	13.0	2.60	6.5	2200	113.3	5.93	93.1	117.7	5.60	11.1	90	10.0	2.15	5.0	1800	55.0	44.5	0.81	4.43	70.2	12.4	7.8
	17.0	5.22	12.1	1800	112.5	6.40	90.6	127.9	5.15	13.4		13.5	3.34	7.7	1500	55.0	43.1	0.78	4.17	69.3	13.2	7.3
			_	2200	115.5	6.18	94.4	118.6	5.48	11.9		<u> </u>	<u> </u>	_	1800 1500	55.6 50.2	44.9	0.81	4.30	70.3 67.2	12.9	7.4 10.3
	8.5	1.55	3.6									6.5	0.92	2.1	1800	50.7	42.5	0.84	5.15	68.2	9.8	10.3
100	13.0	2 70	62								100	10.0	2.07	18	1500	50.7	41.1	0.81	4.79	67.0	10.6	9.7
'00	15.0	2.70	0.2									10.0	2.07	7.0	1800	51.2	42.8	0.84	4.90	67.9	10.4	
	17.0	5.03	11.6									13.5	3.22	7.5	1500	51.2 51.7	41.6	0.81	4.68	67.1 68.0	10.9	
															1800 1500	46.4	43.3 39.0	0.84	4.77 5.55	65.3	10.8	
	8.5	1.50	3.5									6.5	0.89	2.1	1800	46.8	40.6	0.87	5.61	66.0	8.4	13.1
110	13.0	2.60	60		Opera	ition no	t recom	mend	ed		110	10.0	2.00	46	1500	46.8	39.5	0.84	5.32	65.0	8.8	12.3
	15.0	2.00	0.0		Opera	121011110	. 1000111	menu	cu			10.0	2.00	7.0	1800	47.3	41.2	0.87	5.37	65.7	8.8	12.4
	17.0	4.84	11.2									13.5	3.10	7.2	1500 1800	47.3 47.8	40.0	0.85	5.19 5.24	65.0 65.7	9.1	11.6 11.7
\vdash												\vdash			1500	42.8	38.6	0.87	6.32	64.4	6.8	16.1
	8.5	1.40	3.2									6.5	0.85	2.0	1800	42.2	39.2	0.93	6.15	63.2	6.9	16.2
120	13.0	2.50	5.8								120	10.0	1.92	44	1500	43.3	39.2	0.90	6.05	64.0	7.2	15.2
	10.0	2.50	0.0								0	-0.0			1800	42.5	39.9	0.94	6.07	63.2	7.0	15.3
1	17.0	4.65	10.7									13.5	2.98	6.9	1500 1800	43.5 43.2	40.0	0.92	5.90 5.89	63.6	7.4	14.3 14.5
	ш														1000	43.2	40.3	0.93	5.09	03.3		14.5 7/70/1E

Performance capacities shown in thousands of Btuh.

7/30/15

Contractor:	P.O.:


7 Series 700A11 3-5 Ton 60Hz

Engineer: ______ Unit Tag: _____



Wiring Schematics

Aurora Variable Speed

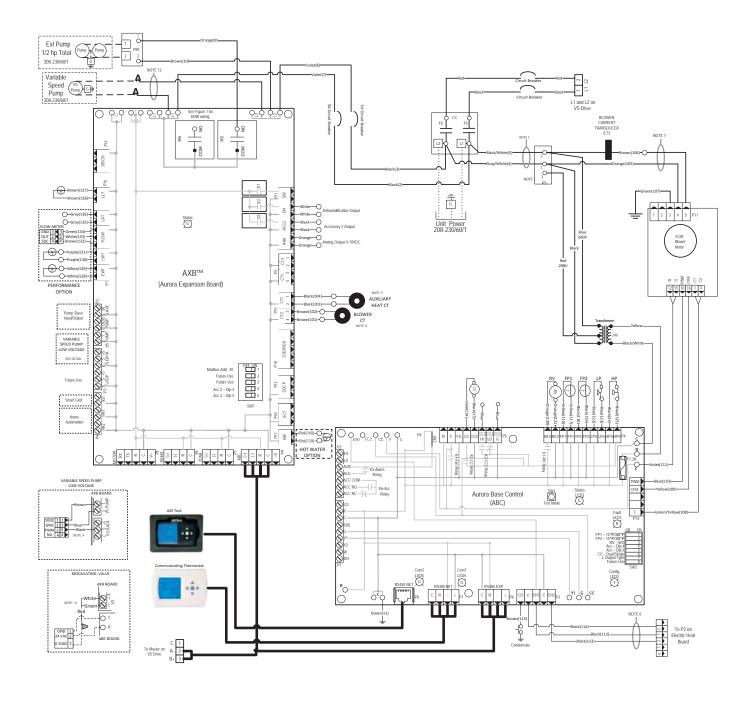


97P842-01A


Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	





Aurora Variable Speed cont.

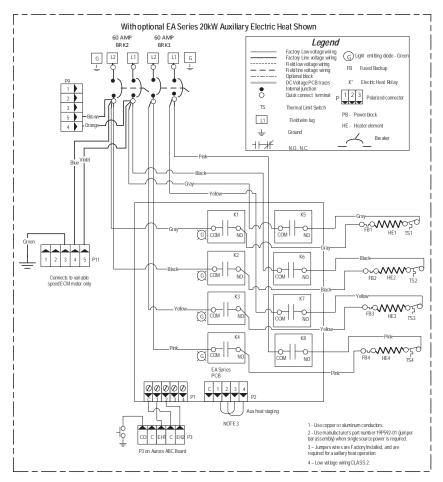



Notes

- Switch blue and red wires for 208V operation.
 The blk/wh and gray/wh wires are removed when Aux Heat is installed
- Use manufacturer's part number 1995-92-01 (jumper bar assembly)
 when single source power is required.
 Variable Speed pump bow voldage hamess provided with Variable Speed Flow Center.
 Low vollage wring CLASS 2.
- 5 Low voltage wiring CLASS2.

 6 Wires provided for Auxiliary Heat low voltage control. Wires are secured at blower.

 7 When Auxiliary Heat is field installed the harmess will hiere be connected to
 the auxiliary heat unit. The auxiliary heat unit will then power the blower. Refer to
 EASEAMEAL Auxiliary Heat hit installation instructions.

 8 Brown blower power wire routed through Current Transducer two times.

 9 Field Connected: Refer to installation Manual and Auxiliary Heat Instructions for
 Current Transducer installation.

 10 Communication cable routed through Ferrite Toroid thur times.

- 10 Communication case routed moting in-emite foliotio but intess:
 11 Cornje rosp power cable routed through Fernite Toroid three times.
 12 Variable speed pump power wires to connect the pump to L1 and L2 on the AXB board are provided with Variable Speed Folio Center.
 13 Feld installed SPST relay required for dual fuel Installation.
 114 Withing harms supplied with valve.

Page 1


97P842-01A

Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	





Aurora Variable Speed Drive/EEV Wiring

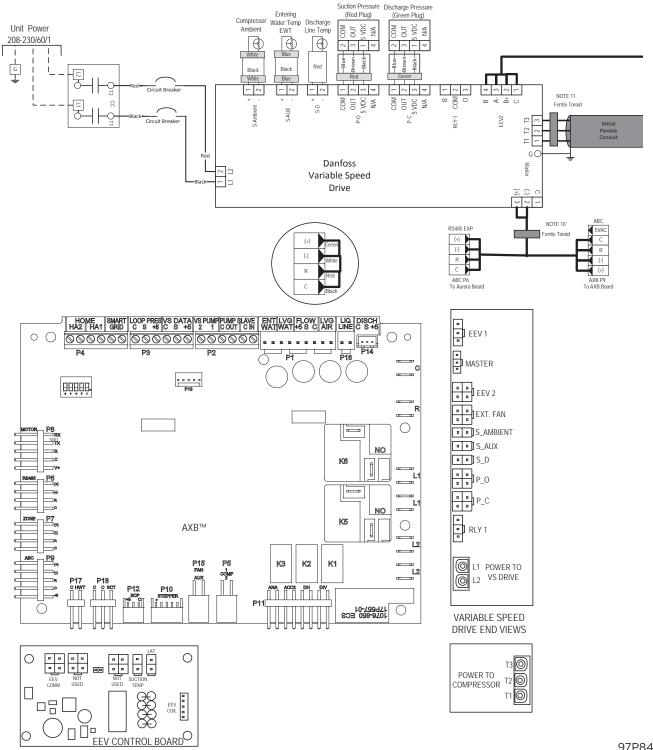


97P842-01B


Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:





Aurora Variable Speed Drive/EEV Wiring cont.

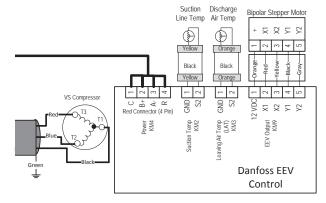

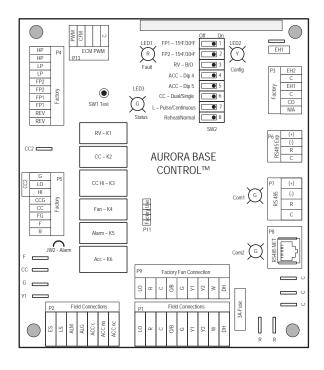

Legend				
	Factory Low voltage wiring Factory Line voltage wiring	(T)	Thermistor	
	Field low voltage wiring Field line voltage wiring	Q	Light emitting diode - Green	
	Optional block DC Voltage PCB traces	\circ	Relay coil	
•	Junction Ouick connect terminal	H.	Capacitor w/ bleed resistor	
Ā	Quick connect terminal Wire nut	90	Switch - Condensate overflow	
11	Field wire lug	To	Switch - High pressure	
	Ground	20	Switch - Low pressure	
- - 	Relay Contacts- N.O., N.C.	p 2 3 1	Polarized connector	
Blue	Fuse Color identification tape on wire.		Current Transducer (CT)	
CC - CO - K5 - K6 - CR3 - CR4 - CS -	Compressor Contactor Condensate overflow sensor DHW pump relay Loop pump relay PSC Fan Speed Relay PSC Fan Power Relay Compressor Solenoid	PB1, PB2 - PS - RV - SW1 - SW1 - SW2 -	Power blocks Power strip Reversing Valve coil DIP package 5 position AXB TEST MODE ABC Board DIP package 8 position ABC Board	
F1 and F2 - HE - HP - ER1 to ER4 - LP -	Fuses Heater element High pressure switch Aux heat stage relays Low pressure switch	TS - HWL - SC - SR - WCL -	Thermal limit switch Hot water limit sensor Start Contactor Start Relay Water Coil Limit Sensor	

		Aurora LED	Flash Codes		
Slow Flash	1 second on and 1 second off				
Fast Flash	100 milliseconds on and 100 mi	100 milliseconds on and 100 milliseconds off			
Flash Code	100 milliseconds on and 400 mi	liseconds off with a	2 second pause before repeating		
	Fault LED (LED 1, Red) Random Start Delay (Alternating Colors)				
Normal Mode		OFF	Status LED (LED1, Green)	Fast Flash	
Input Fault Lo	ockout	Flash Code 1	Configuration LED (LED 2, Yellow)	Fast Flash	
High Pressur	e Lockout	Flash Code 2	Fault LED (LED 3, Red)	Fast Flash	
Low Pressure	e Lockout	Flash Code 3	Configuration LED (LED 2, Y	rellow)	
Freeze Dete	ction- FP2	Flash Code 4	No Software Overide	OFF	
Freeze Dete	ction - FP1	Flash Code 5	DIP Switch Overide	Slow Flash	
Reserved		Flash Code 6	Status LED (LED 3, Gree	en)	
Condensate	Overflow Lockout	Flash Code 7	Normal Mode	ON	
Over/Under '	Voltage Shutdown	Flash Code 8	Control is Non - Functional	OFF	
Future Use		Flash Code 9	Test Mode	Slow Flash	
Compressor	Monitoring	Flash Code 10	Lockout Active	Fast Flash	
Fault- FP1 ar	nd FP2 Sensor Error	Flash Code 11	Dehumidification Mode	Flash Code 2	
Future Use		Flash Code 12	Future Use	Flash Code 3	
Non-Critical A	AXB Sensor Error	Flash Code 13	Future Use	Flash Code 4	
Critical AXB 9	Sensor Error	Flash Code 14	Load Shed	Flash Code 5	
Alarm - Hot V	Vater	Flash Code 15	ESD	Flash Code 6	
Fault Variable Speed Pump		Flash Code 16	Future Use	Flash Code 7	
Future Use		Flash Code 17	Fault LED (LED 1, Red) Cont.		
Non-Critical Communication Error		Flash Code 18	Safe Mode - Ambient Temperature Sensor	Flash Code 49	
Fault - Critica	l Communication Error	Flash Code 19	Fault - Discharge Temperature Sensor	Flash Code 51	
Alarm - Low	Loop Pressure	Flash Code 21	Fault - Suction Pressure Sensor	Flash Code 52	
Fault - Comm	nunication ECM Fan Motor Error	Flash Code 22	Fault - Condensing Pressure Sensor	Flash Code 53	
Alarm - Home	e Automation 1	Flash Code 23	Fault - Low Supply Voltage	Flash Code 54	
Alarm - Home	e Automation 2	Flash Code 24	Fault - Compressor Out of Envelope	Flash Code 55	
Fault - EEV E	Error	Flash Code 25	Fault - Over Current	Flash Code 56	
Derate - Driv	e Temperature	Flash Code 41	Fault - Over/Under Voltage	Flash Code 57	
Derate - High	n Discharge Temperature	Flash Code 42	Fault - High Drive Temperature	Flash Code 58	
Derate - Low	Suction Temperature	Flash Code 43	Fault - Drive Internal Error MOC/AOC	Flash Code 59	
Derate - Low	Condensing Pressure	Flash Code 44	Fault - Multiple Safe Modes	Flash Code 61	
Derate - High	Condensing Pressure	Flash Code 45	Fault - Loss of Charge	Flash Code 71	
Derate - Oute	er Power Limit	Flash Code 46	Safe Mode - Suction Temperature Sensor	Flash Code 72	
Safe Mode -	EEV (Indoor) Communication	Flash Code 47	Safe Mode - LAT Temperature Sensor	Flash Code 73	
Safe Mode -	EEV (Outdoor) Communication	Flash Code 48	Safe Mode - Max Operating Pressure	Flash Code 74	

	AXB Accessory 2 DIP Settings		
SV	V1-4	SW1-5	DESCRIPTION
(NC	ON	Cycles with Blower
С)FF	ON	Cycles with CC first stage compressor or compressor spd 1-12
(NC	OFF	Cycles with CC2 second stage of compressor or comp spd 7-12
С)FF	OFF	Cycles with DH from ABC board

ABC SW2 Accessory Relay			
DESCRIPTION	SW2-4	SW2-5	
Cycle with Blower	ON	ON	
Cycle with Compressor	OFF	OFF	
Water Valve Slow Opening	ON	OFF	
Cycle with Comm. T-stat Hum Cmd	OFF	ON	

97P842-01B

Contractor:	P.O.:	
Engineer:		

Unit Tag: _


7 Series 700A11 3-5 Ton 60Hz



Wiring Schematics cont.

Project Name:

Aurora Variable Speed with UPC

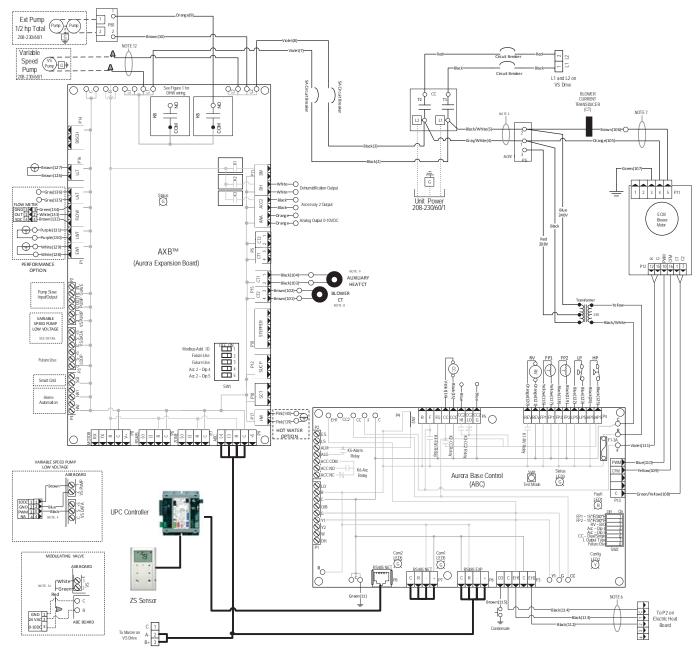



Contractor:	P.O.:	
Engineer:		
Project Name:	Unit Tag:	





Aurora Variable Speed with UPC cont.

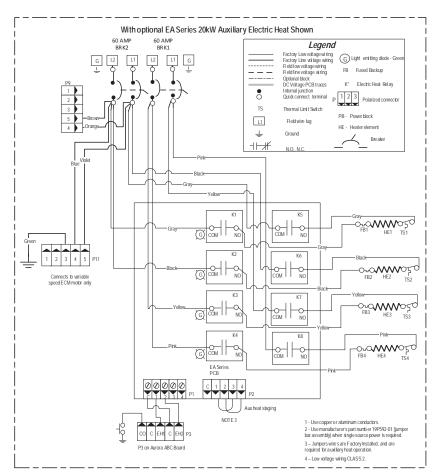



ABC Board

Notes 1 - Switchblue and red wires for 288V operation. 2 - The bikWh and gray/wh wire are removed when Aux Heat is installed 3 - Use manufacturers part number 19599-01 (jumper bar assemtly) when single source power is required. 4 - Variable Speed pump low vollage harmess provided with Variable Speed Flow Certer. 5 - Low voltage wring LASS 2. 6 - Wires provided for Auxilary Heat low voltage contri. Wires are secured at blower. 7 - When Auxilary Heat is field installed the harmess will fine he connected to the auxiliary heat tim. The auxiliary heat until will then power the blower. Refer to EAS/EA/MEAL Auxiliary Heat M installation instructions. 8 - Brown blower power wire routed through Current Transducer two times. 9 - Field Connected: Refer to Installation Manufacture Auxiliary Heat Instructions for Current Transducer installation. 11 - Communication cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times. 11 - Compressor power cable routed through Ferrite Toroid four times.

Contractor	1	P.O.:
Engineer:_		


___ Unit Tag: ___





Wiring Schematics cont.

Project Name:_____

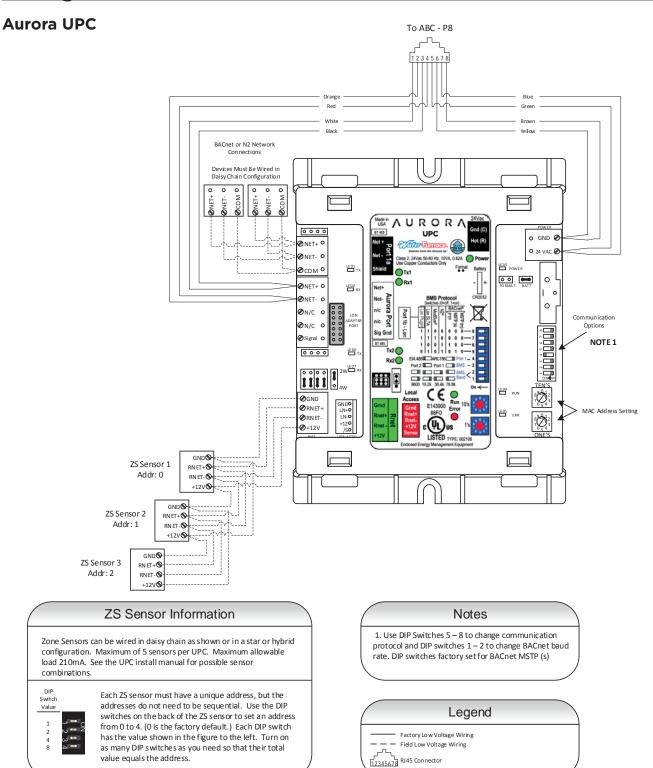

Contractor:	P.O.:	
Engineer:		
Droject Name:	Unit Tage	



Engineering Guide Specifications

General

Furnish and install WaterFurnace Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/ cooling units shall be either suspended type with horizontal air inlet and discharge or floor mounted type with horizontal air inlet and vertical upflow, downflow, or rear air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2-inch thick, multi-density, cleanable aluminum foil coated glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge air. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

One (horizontal) to two (vertical) blower and three compressor compartment access panels shall be 'lift-out' removable with supply and return ductwork in place. The front access panel shall be lift-out to provide easy access to the electrical/compressor section. The control box shall be hinged and removable to allow easy access to the compressor. The internal component layout shall provide for service access from the front side for restricted installations.

A duct collar shall be provided on the supply air opening. Standard size 2 in. [5.1 cm] MERV 11 pleated filters shall be provided with each unit. Vertical and horizontal units shall have a return air filter rack/duct collar which is field convertible from 2 in. [5.1 cm] to 1 in. [2.5 cm]. The upflow vertical units shall have a removable insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise and to permit operational service testing without air bypass. Vertical units shall be supplied with left or right horizontal air inlet and top, bottom, or rear vertical air

discharge. Horizontal units shall be supplied with left or right air inlet and side or end air discharge.

The compressor shall be double isolation mounted using selected durometer grommets to provide vibration free compressor mounting.

The drain pan shall be of plastic construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection. Mechanical float switches WILL NOT be accepted. Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap.

Refrigerant Circuit

All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, discharge line muffler, bidirectional electronic expansion valve, finned tube airto-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, optional hot water generator coil, and service ports. Compressors shall be high-efficiency variable speed scroll type designed for heat pump duty and mounted on double vibration isolators.

Compressor motors shall be permanent magnet type. The FormiShield Plus electro-coated coil shall be sized for low-face velocity and constructed of patented 11 element lanced aluminum fins bonded to rifled copper tubes in a staggered pattern not less than three rows deep for enhanced performance. All models shall include discharge mufflers to help quiet compressor discharge gas pulsations.

Refrigerant to air heat exchangers shall utilize rifled copper tube construction rated to withstand 600 psig (4135 kPa) refrigerant working pressure. Refrigerant to water heat exchangers shall be of copper (cupronickel optional) inner water tube and steel refrigerant outer tube design, rated to withstand 600 psig (4135 kPa) working refrigerant pressure and 450 psig (3101 kPa) working water pressure. An electronic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bidirectionally without the use of check valves.

All units shall have the source coaxial tube refrigerant-to water heat exchanger and the optional hot water generator coil coated with ThermaShield insulation. Refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures.

Contractor:	P.O.:
Engineer:	
Project Name:	Unit Tag:



Engineering Guide Specifications cont.

Blower Motor and Assembly

The blower shall be a direct drive centrifugal type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low outlet velocity operation. The blower housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of the blower motor. The blower motor shall be a variable-speed ECM type. The ECM blower motor shall be soft starting, shall maintain constant cfm over its operating static range, and shall provide 12 cfm settings. The blower motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated, have thermostatic overload protection and be long-life ball bearing type.

Electrical

A control box shall be located within the unit compressor compartment and shall contain a 75VA transformer, 24 Volt activated, 2 pole compressor contactor, circuit breakers for protecting loop pumps and compressor drive, removable terminal block for thermostat wiring, variable speed compressor drive and solid-state controller for complete unit operation. Electromechanical operation WILL NOT be accepted. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be communicating type and provide heating or cooling as required by the remote thermostat/sensor. An Aurora Advanced VS Control, a microprocessor based controller, interfaces with a digital communicating thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, blower failure, high and low pressure switch monitoring, freeze detection, hot water limit thermistor sensing, condensate overflow sensing, auxiliary heat staging, lockout mode control, hot water and loop pump control, LED status and fault indicators, fault memory, field selectable options, compressor envelope management, energy consumption measurement, and accessory output. The fault signals shall be plain English text and displayed on the thermostat.

The Aurora Advanced VS Control shall also feature an On Peak input signal for utility controlled demand programs, intelligent hot water generation with user adjustable temperature limit, loop pump slaving for multiple units driving a common flow center and up to two optional home automation inputs to drive dedicated alarms for sump pump, security system, and smoke/CO2 or dirty air filter sensors. As standard, the energy and refrigerant monitoring kits will provide real time data including total power consumption, refrigerant superheat and subcooling. Optional performance monitoring kit to provide real time data including, entering and leaving water temperature, flow rate and heat of extraction/rejection capacity data. The capability for communicating to advanced zoning packages with up to six zones shall also be provided with complete fault and information display on the zoning MasterStat.

A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

An optional Aurora Interface Diagnostic (AID) Tool shall communicate with the Aurora control allowing quick and easy access to setup, monitoring, and troubleshooting of any Aurora control. The device shall include the features of ECM airflow setup, VS pump and modulating water valve setup, fault description and history, manual operation capability, sensor readings, timings, and other diagnostic tools.

Option: An Aurora Unitary Protocol Converter (UPC) shall be included that communicates directly with the Aurora Heat Pump Control and allows access/control of a variety of internal Aurora heat pump operations such as sensors, relay operation, faults and other information. In turn, the UPC shall convert the internal Aurora Modbus protocol to BACnet MS/TP protocol for communication over a HAS system. Additional individual unit configuration items such as ECM fan speeds or freeze protection settings shall be directly available over the HAS without the need for access to the actual heat pump.

Piping

Supply and return water connections shall be 1 in. [25.4 mm] FPT brass swivel fittings, which provide a union and eliminate the need for pipe wrenches and sealants when making field connections. The optional hot water generator shall have sweat type connections. All source water piping shall be insulated to prevent condensation at low liquid temperatures. On the vertical units, the condensate connection shall be a 3/4 in. [19.1 mm] PVC socket with internally-trapped hose that can be routed to front or side locations.

Hanger Kit

(field-installed horizontal units only)

The hanger kit shall consist of galvanized steel brackets, bolts, lock washers, and isolators and shall be designed to fasten to the unit bottom panel for suspension from 3/8-inch threaded rods. All unit size shall include six brackets hanging brackets.

Options and Accessories Cupronickel Heat Exchanger

An optional cupronickel water-to-refrigerant heat exchanger shall be provided.

Contractor:	P.O.:
Engineer:	
Project Name	Unit Tag:



Engineering Guide Specifications cont.

Hot Water Generator

An optional ThermaShield coated heat reclaiming hot water generator coil of vented double-wall copper construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit with integral electronic high limit temperature monitoring and external on/off switch. Hot water set point is selectable through the AID Tool.

AlpinePure 411-Rack 4 in. Pleated Filter Accessory

A 4 in. [102 mm] thick MERV 11 filter and filter rack shall be provided in lieu of the standard filter and rack.

Thermostat (field-installed)

A communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO-INTERMITTENT blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C. The thermostat shall provide real time energy consumption data of the unit.

Color Touchscreen Thermostat (field-installed)

A color touchscreen communicating auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer variable speed heating and cooling staging with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO-INTERMITTENT blower switch, and indicating display shall be provided. The thermostat shall display in °F or °C. The thermostat shall provide real time and historical energy consumption data of the unit.

Electronic Air Cleaner (field-installed)

A 1 in. [25 mm] electronic air cleaner, cleanable 97% efficiency at 0.3 microns and larger, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.2 in. w.g. at 300 fpm force velocity.

Electrostatic Air Cleaner (field-installed)

A 1 in. [25 mm] electrostatic air cleaner, cleanable 90% efficiency, shall be provided in lieu of the standard throwaway filter. The initial pressure drop across the filter shall not exceed 0.15 in. w.g. at 300 fpm force velocity. AlpinePure 411–Rack 4 in. Pleated Filter Accessory A 4 in. [102 mm] thick MERV 11 filter and filter rack shall be provided in lieu of the standard filter and rack.

AlpinePure MERV 13 Filter (field-installed)

A 2 in. [50 mm] thick MERV 13 filter shall be provided in lieu of the standard filter and fits the factory filter rack. The filter maintains MERV 13 rating in full ASHRAE 52.2 independent testing as required for LEED® certification. Helps fulfill a full credit under the LEED rating system.

AlpinePure Drain Pan Treatment (field-installed)

Provides dependable, sustained time-release protection from slime build-up and foul smelling odors in the drain pan. Also adds a light, pleasant scent to the air.

Earth Loop Flow Center (field-installed)

A self-contained module shall provide all liquid flow, fill and connection requirements for ground source closed loop systems up to 20 gpm. The pumps shall be wired to a power block located in the nearest unit. The heat pump units shall contain low voltage pump slaving control so that two units may share one flow center.

Auxiliary Heater (field-installed)

An electric resistance heater shall provide supplemental and/or emergency heating capability. Vertical units shall have the control panel and resistance heater coil assembly mounted internally. For horizontal units, the control panel shall be mounted internally while the resistance heater coil assembly shall be mounted externally. A low voltage plug shall be provided in each unit for quick auxiliary heat connection. The heater shall operate in sequenced stages as controlled by the unit's microprocessor. The heater shall feed line voltage power to the unit blower and transformer to provide emergency heat capability in the event of an open compressor circuit breaker.

Contractor:	P.O.:	_
Engineer:		_
Project Name:	Unit Tag:	

7 Series 700A11 3-5 Ton 60Hz

Revision Guide

Pages:	Description:	Date:	Ву:
24,25	Updated Wiring Schematics, Engineering Specifications to include UPC option	21 Nov 2017	MA
All	Misc. Updates	9 Dec 2016	MA
All	Misc. Updates, Performance Data Update	12 Aug 2016	MA
All	Electric heating updates, multiple areas effected	07 Jan 2015	MA
20 - 23	Updated Wiring Diagrams	31 May 2013	DS
27	Added Revision Guide	31 May 2013	DS